



INSTALLATION INSTRUCTIONS

**MODEL DuraSeal®
DS-DSD-DSID (3" to 24")
DSLS-DSL D (26" to 36")**



MODEL DS



MODEL DSD



MODEL DSID



MODEL DSLS



MODEL DSLD

**SAVE THESE INSTRUCTIONS
FOR FUTURE REFERENCE**



Listed to standards:
UL-1738
ULC-S636 Type "BH" vent
UL-641 (DSD/DSID ONLY)
ULC-S609 (DSD/DSID ONLY)
Report # G100215896MTL-006

**Single Wall or Double Wall AL29-4C® or 316L
Special Gas Vent for Category I, II, III and IV
TYPE L VENT Low Temperature Venting System (3" to 24")**

3" to 36" Diameter Vent for use on Positive, Neutral and Negative Pressures up to 35" W.C.

Also for venting listed gas or oil fired appliances listed for venting with TYPE L low temperature venting system (DSD-DSID ONLY 3" to 24")

This installation manual will enable you to obtain a safe, efficient and dependable installation of this vent system. Please read and understand these instructions before beginning your installation.

Do not alter or modify the components of this chimney system under any circumstances. Any modification or alteration of the vent system or approved accessories, including but not limited to the appliance it is connected to, may void the warranty, listings and approvals of this system and could result in an unsafe and potentially dangerous installation.

- A. Examine all components for possible shipping damage prior to installation.
- B. Proper joint assembly is essential for a safe installation. Follow these instructions exactly as written: Check severeness of joints upon completion of assembly.
- C. This venting system must be free to expand and contract. This venting system must be supported in accordance with these instructions.
- D. Check for unrestricted vent movement through walls, ceilings, and roof penetrations.
- E. Different manufacturers have different joint systems and adhesives. Do not mix pipe, fittings, or joining methods from different manufacturers.

⚠ WARNINGS

FAILURE TO FOLLOW THESE INSTALLATION INSTRUCTIONS COULD CAUSE FIRE, CARBON MONOXIDE POISONING, OR DEATH. IF YOU ARE UNSURE OF INSTALLATION REQUIREMENTS, CALL THE PHONE NUMBER LISTED ON THE BACK OF THESE INSTRUCTIONS.

A MAJOR CAUSE OF CHIMNEY RELATED FIRE IS FAILURE TO MAINTAIN REQUIRED CLEARANCES (AIR SPACES) TO COMBUSTIBLE MATERIALS. IT IS OF UTMOST IMPORTANCE THAT THIS VENT SYSTEM BE INSTALLED ONLY IN ACCORDANCE WITH THESE INSTRUCTIONS

TABLE OF CONTENTS

SECTION A:

General Information for All MODELS

DS - DSD - DSID - DSLS - DSLD

Introduction.....	page 2
Testing/ listing information.....	page 2
Part numbers	page 3
Effective length.....	page 3
Clearances to combustibles	page 3
General installation requirements	page 4
Chimney weight	page 4
Support methods and height.....	page 4
Guying and Bracing.....	page 5
Horizontal installation requirements	page 6
Vertical installation requirements	page 7
Roof/floor penetration	page 7
Maintain proper slope	page 7
Wall penetration	page 8
Condensate drains	page 9

SECTION B:

Specific Information for Models DS, DSD and DSID (3" to 24")

Typical installations (DS-DSD-DSID)	page 10
Chimney and fitting joint assembly (DS-DSD-DSID)	page 12
Adjustable length (DS-DSD-DSID)	page 13
Telescopic adjustable length (DS-DSD-DSID).....	page 13
DuraSeal as a liner	page 14
DuraSeal® Flex	page 14

SECTION C:

Specific Information for Models DSLS and DSLD (26" to 36")

Typical Installation (DSLS-DSLSD)	page 19
Guying and Bracing (DSLS-DSLSD).....	page 20
Joint Assembly (DSLS-DSLSD)	page 21
Straight Sections (DSLS-DSLSD).....	page 21
Installation steps for Variable Length (LV) (DSLS-DSLSD).....	page 22
CAPS (DSLS-DSLSD).....	page 25
Elbows (DSLS-DSLSD)	page 25
Offset (DSLS-DSLSD)	page 25
Adapters (DSLS-DSLSD).....	page 26
Supports (DSLS-DSLSD)	page 28
Ventilated Anchor Plate with Length (DSLS-DSLSD).....	page 28
Heavy Duty Wall Support (DSLS-DSLSD)	page 29
Heavy Duty Wall Guide (DSLS-DSLSD)	page 30
Full Angle Ring (DSLS-DSLSD).....	page 30
Half Angle Ring (DSLS-DSLSD)	page 30
Location of supports (DSLS-DSLSD).....	page 31
Flashings and Storm Collar (DSLS-DSLSD)	page 32
Maintenance instructions	page 33
Warranty & Product Reference information	page 33

SECTION A:

GENERAL INFORMATION FOR ALL MODELS

DS - DSD - DSID - DSLS - DSLD

INTRODUCTION

DuraSeal® single wall (DS 3"-24", DSLS 26"-36") or double wall (DSD 3"-24", DSLD 26"-36") is a special stainless steel vent system for gas fired appliances listed as Category I, II, III, and IV in USA UL 1738 or in Canada as Type BH Gas Venting as noted in ULC-S636, with a maximum operating temperature of 480°F (250°C), and a maximum rated positive pressure of 35" water column. It can also vent listed gas or oil fired appliance rated to be vent with TYPE L low temperature venting system (DSD & DSID only). DuraSeal® must be installed by an experienced professional familiar with the operation and maintenance of heating appliances and venting. Before installing this product, examine all components for possible shipping damage and read the complete installation manual. Failure to follow proper installation procedures, including vent pitch and improper appliance connections, may cause unsafe conditions. DuraVent Limited recommends the system to be inspected once a year by a qualified service technician.

Model DuraSeal may be installed outside the building envelope where required providing the installation meets local code requirements. In colder climates it is recommended to use model DSID which has a 2" fiber insulation between the annular space. The insulation ensures reduced velocity noise and can protect the flue gas from freezing up to -20°C (-4°F). Do not install a drain fitting on exterior / make sure the DSID is brought into the interior building envelope by at least 2-feet.

TESTING/LISTING INFORMATION

DuraVent Ltd. DuraSeal® model DS, DSD, DSID, DSLS and DSLD venting system is listed with Intertek Testing Services (ETL) to UL/ULC standards:

U.S.A.

- UL-1738
Special Gas Category I, II, III and IV appliances
- UL-641 (DSD & DSID only)
TYPE L VENT venting listed gas or oil burning appliances

CANADA

- ULC-S636
Type BH Gas Vent Class I/II
- ULC-S609 (DSD & DSID only)
TYPE L VENT venting of flue gases with temperature not exceeding 300°C from oil and gas burning appliances

This product must be installed in accordance with local building code requirements as well as national codes: USA - National Fuel Gas code ANSI-Z223.1 or NFPA Standard 54, or NFPA 211. CANADA - CAN/CSA B-149.1 Natural Gas and Propane Installation code as applicable.

PART NUMBERS

These instructions identify major model DS-DSD-DSID parts by name and part number.

Material Code Designations	
B	Type 316 Stainless Steel
H	Type 430 Stainless Steel
K	Type 441 Stainless Steel
P	Type 439 Stainless Steel
U	Type AL29-4C Stainless Steel

Example:

DSD 36" length with inside diameter 14" made of AL29-4C inner flue and SS441 outer casting.

DSD	14	L36	UK
Model	Dia.	Part	Material

DS 30° elbow with inside diameter 22" made of 316L.

DS	22	E30	B
Model	Dia.	Part	Material

DSD wall support for 8" diameter chimney made of stainless 439.

DSD	8	WSDH	P
Model	Dia.	Part	Material

Use only factory-supplied components. Failure to do so will void the certification and the warranty of the chimney system.

EFFECTIVE LENGTH

DS-DSD-DSID (3"-24")

When assembling two parts together, the joint will overlap 2-3/8". Effective length is nominal length minus 2-3/8".

Example:

		Effective Length
L36	»	33-5/8"
L24	»	21-5/8"
L18	»	15-5/8"
L12	»	9-5/8"
L9	»	6-5/8"

DSLS-DSL (26"-36")

The effective length is the length of the part when it is assembled.

Example:

		Effective Length
L36	»	35-9/16"
L24	»	24-1/16"
L18	»	17-9/16"
L12	»	11-9/16"

CLEARANCES TO COMBUSTIBLES

Table 1 shows the required MINIMUM AIRSPACE CLEARANCE TO COMBUSTIBLES. "Combustibles" include framing lumber, drywall, plywood, paneling, insulation, wiring, and other building materials.

Minimum Clearance to Combustibles Single Wall DS - DSLS						
Diameter	Rated Operating Temp	Max Operating Temp	Enclosed (4 sides)		Unenclosed (2 sides max.)	
			Horiz.	Vert.	Horiz.	Vert.
3" to 12"	480°F (250°C)	550°F (288°C)	N/A	N/A	2"	2"
14" to 24"	480°F (250°C)	550°F (288°C)	N/A	N/A	4"	4"
26" to 36"	480°F (250°C)	550°F (288°C)	N/A	N/A	6"	6"
Minimum Clearance to Combustible Double Wall DSD - DSID - DSLD						
Diameter	Rated Operating Temp	Max Operating Temp	Enclosed (4 sides)		Unenclosed (2 sides max.)	
			Horiz.	Vert.	Horiz.	Vert.
3" to 12"	480°F (250°C)	550°F (288°C)	N/A	1"	1"	1"
14" to 24"	480°F (250°C)	550°F (288°C)	N/A	1"	3"	1"
26" to 36"	480°F (250°C)	550°F (288°C)	N/A	2"	6"	2"
3" to 12" L-Vent	480°F (250°C)	550°F (288°C)	N/A	2"	2"	2"
14" to 24" L-Vent	480°F (250°C)	550°F (288°C)	N/A	2"	3"	2"

Table 1 - Minimum Clearances for DuraSeal®

Auxiliary parts such as combination Roof Supports, Roof Thimble, Flashings, and Wall Thimble outer shields are intended to be attached directly to the framing or to ceilings, floors, or walls in accordance with their respective instructions. These parts, which are installed in contact with wood or other combustibles, are designed and tested to assure that they do not overheat at points of contact.

Notes:

1. Unenclosed requires at least two sides open.
2. Single Wall (DS/DSLS) may be enclosed only in non-combustible enclosure.
3. Reduced clearances may be attained by using non-combustible enclosures.
4. Combustible material is any material made of or surfaced with wood, compressed paper, plant fibers, or other materials that are capable of being ignited or burned. Such material shall be considered combustible even though it is flame-proofed, fire-retardant treated, or plastered.
(Source: NFPA 54/ANSI Z223.1)
5. Design any enclosure to permit inspection of the system.
6. Do not place insulation in any required clearance spaces surrounding the vent system unless these instructions suggest otherwise and the insulation is specified or supplied.
7. When using Viton caulking, follow the manufactures required drying times.

GENERAL INSTALLATION REQUIREMENTS

When venting Category I, II, III, or IV appliances or TYPE L vented appliance, DuraSeal® **must** be used for the entire length of the system. Do not mix pipe, fittings, or joining methods from different manufacturers. **See the DuraSeal® catalog for a complete list of parts and products.** Every vent system must be planned and installed for optimum performance and safety. The venting system must be free to expand and contract and must be supported in accordance with these instructions (Check for unrestricted vent movement through walls, ceilings, and roof penetrations). Refer to the gas appliance manufacturer's instructions to determine venting requirements and limitations with respect to installation and use of the appliance. **It is the responsibility of the installer to contact local building and fire officials concerning any installation restrictions and/or inspection requirements that may apply.** Permits may be required before starting an installation.

- If required by the appliance manufacturer, a Drain Tee Cap must be located as close as possible to the appliance flue outlet. Depending on the arrangement of the vent, **more than one drain may be required.** Unless a Drain Tee Cap is supplied with the appliance, install a DuraSeal® Drain Tee Cap.
- More than one Category II, III, IV appliance may not be connected into the same vent system, unless the appliance manufacturer specifically approved such a system and the appliance are designed for multiple venting. Cat. II, III or IV appliances MAY NOT be common vented with Cat. I, natural draft appliances. This limitation can be removed if an engineering analysis demonstrates normal and safe operation of appliances.
- DuraSeal® must not come in contact with plumbing or electrical systems.
- Maintain rated clearances to combustibles over the entire length of the vent system.
- DuraSeal® shall not be routed into, through, or within any vent, such as an existing masonry or factory-built chimney, that is **connected to another appliance.**
- Transition parts are available to connect model DS & DSD to DSLS & DSLD larger size. Refer to DuraVent technical assistance for guidance.

CHIMNEY WEIGHT (DS-DSD-DSID-DSLS-DSL D)

Chimney weight is given in pounds per foot for each diameter. It is important to know the weight of the chimney section for chimney support or guiding. Chimney weight (**table 2**) along with the maximum chimney height (**table 3, 4, 5, & 6**) is necessary to calculate the proper anchor strength needed with supports.

CHIMNEY WEIGHT IN LB/FT					
INSIDE DIAMETER	DS	DSD	DSID	DSLS	DSL D
3"	.7	1.7	2.1	N/A	N/A
4"	0.9	2.1	2.6	N/A	N/A
5"	1.1	2.6	3.0	N/A	N/A
6"	1.3	3.0	3.4	N/A	N/A
7"	1.5	3.4	3.9	N/A	N/A
8"	1.7	3.8	4.3	N/A	N/A
9"	1.9	4.3	N/A	N/A	N/A
10"	2.1	4.7	5.5	N/A	N/A
12"	2.6	6.2	7.0	N/A	N/A
14"	3.6	7.7	8.2	N/A	N/A
16"	4.1	8.7	9.3	N/A	N/A
18"	4.6	9.8	10.3	N/A	N/A
20"	5.1	10.8	11.3	N/A	N/A
22"	5.7	11.8	12.4	N/A	N/A
24"	6.2	12.8	N/A	N/A	N/A
26"	N/A	N/A	N/A	10.4	17.9
28"	N/A	N/A	N/A	11.2	19.3
30"	N/A	N/A	N/A	12.0	20.7
32"	N/A	N/A	N/A	12.3	22.1
34"	N/A	N/A	N/A	13.6	23.5
36"	N/A	N/A	N/A	14.4	24.8

Table 2- Chimney weight

Example: Model DuraSeal DSD 6" diameter section of 25 feet in length, weight in lb/ft = 3. Total length 3 x 25 = 75lbs.

GENERAL INFORMATIONS FOR SUPPORTS AND GUIDES (DS-DSD-DSID-DSLS-DSL D)

1. Several support and guiding methods are used to anchor a chimney against upward, downward and angular placement.
2. These supports and guides prevent bending stresses on the chimney elbows and joints.
3. Certain limitations apply for proper installation of supports and guides. For supports, see **Table 3, 4, 5 & 6**, and for Distance between Guides/ supports, see **Table 7 & 8**.
4. For Typical installation, see **Figure 5 & 6** for Models DS, DSD & DSID and **Figure 26 & 27** for Models DSLS & DSL D.

MAXIMUM CHIMNEY HEIGHTS AND SUPPORT METHOD FOR MODEL DS							
Inside dia.	Anchor Plate (AP)	Anchor Plate Length (APL)	Anchor Plate HD (APHD)	Wall Support (WS)	Wall Support HD (WSHD)	Roof support (RS)	Guy support (GS)
3"	200	200	200	100	200	100	250
4"	200	200	200	100	200	100	250
5"	195	195	195	97.5	195	97.5	225
6"	190	190	190	95	190	95	190
7"	185	185	185	92.5	185	92.5	160
8"	180	180	180	90	180	90	140
9"	175	175	175	87.5	175	87.5	130
10"	170	170	170	85	170	85	115
12"	160	160	160	80	160	80	90
14"	150	150	150	75	150	75	65
16"	140	140	140	70	140	70	60
18"	130	130	130	65	130	65	55
20"	120	120	120	60	120	60	50
22"	110	110	110	55	110	55	45
24"	100	100	100	50	100	50	40

Table 3: Maximum Chimney Heights DS. Dimensions are in feet

MAXIMUM CHIMNEY HEIGHTS AND SUPPORT METHOD FOR MODEL DSD							
Inside dia.	Anchor Plate (AP)	Anchor Plate Length (APL)	Anchor Plate HD (APHD)	Wall Support (WS)	Wall Support HD (WSHD)	Roof support (RS)	Guy support (GS)
3"	100	100	100	50	100	50	115
4"	100	100	100	50	100	50	115
5"	97.5	97.5	97.5	48.75	97.5	48.75	95
6"	95	95	95	47.5	95	47.5	80
7"	92.5	92.5	92.5	46.25	92.5	46.25	70
8"	90	90	90	45	90	45	65
9"	87.5	87.5	87.5	43.75	87.5	43.75	55
10"	85	85	85	42.5	85	42.5	50
12"	80	80	80	40	80	40	40
14"	75	75	75	37.5	75	37.5	30
16"	70	70	70	35	70	35	27
18"	65	65	65	32.5	65	32.5	25
20"	60	60	60	30	60	30	22
22"	55	55	55	27.5	55	27.5	21
24"	50	50	50	25	50	25	20

Table 4: Maximum Chimney Height for DSD. Dimensions are in feet

MAXIMUM CHIMNEY HEIGHTS AND SUPPORT METHOD FOR MODEL DSID							
Inside dia.	Anchor Plate (AP)	Anchor Plate Length (APL)	Anchor Plate HD (APHD)	Wall Support (WS)	Wall Support HD (WSHD)	Roof support (RS)	Guy support (GS)
3"	95	95	95	47.5	95	47.5	80
4"	95	95	95	47.5	95	47.5	80
5"	92.5	92.5	92.5	46.25	92.5	46.25	70
6"	90	90	90	45	90	45	65
7"	87.5	87.5	87.5	43.75	87.5	43.75	55
8"	85	85	85	42.5	85	42.5	50
9"	N/A	N/A	N/A	N/A	N/A	N/A	N/A
10"	80	80	85	42.5	85	42.5	40
12"	75	75	75	37.5	75	37.5	30
14"	70	70	70	35	70	35	27
16"	65	65	65	32.5	65	32.5	25
18"	60	60	60	30	60	30	22
20"	55	55	55	27.5	55	27.5	21
22"	50	50	50	25	50	25	20
24"	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Table 5: Maximum Chimney Height for DSID. Dimensions are in feet

MAXIMUM HEIGHT LIMITS FOR EACH TYPE OF SUPPORT FOR MODEL DSLS & DSLD			
Parts	Flue Diameter Ø (in)	Height (ft)	
		LDCS	LDCD
Anchor Plate Ventilated (APV)	Ø26 to Ø36	161	82
Anchor plate with length (APVL)	Ø26 to Ø36	172	87
Base supported Tee	Ø26 to Ø36	63	32
Wall Support Heavy Duty (WSHD)	Ø26 to Ø36	64	32

Table 6 : Maximum Height Limits for each Type of Support for Models DSLS & DSLDD

Dimensions are in inches (diameter) and feet (distance)

GUYING AND BRACING (DS - DSD - DSID - DSLS - DSLD)

1. Proper guying and bracing is essential for part of the vent that extends above the roof or parapet wall. The vent at this point is subject to wind conditions and needs special attention for proper stabilization. See **Figure 6** for MODEL DS, DSD & DSID and see **figure 27 and 28** for DSLS & DSLD.
2. If the vent above the roof does not exceed dimension H, no special guying or bracing is required. However, to protect the flashing from lateral movement, a guide must be installed at the roof level. See **Figure 6** for MODEL DS, DSD & DSID and see **figure 27 and 28** for DSLS & DSLD.
3. For vent height above the roof that needs guying or bracing, a support, a small length and a expansion length must be installed near the roof level to absorb the thermal expansion and minimise this effect on the guy wire or brace.
4. When using guy wire, the cable must be slightly slack or loose to allow thermal expansion.
5. When using rigid bracing, the maximum vertical height between supports must be reduced to 5' to compensate thermal expansion.

SUPPORT AND GUIDE SPACING FOR MODEL DS & DSLS						
Inside diameter	MVS		MHS	MDE	H	S
	Interior	Exterior				
3"	10	8	12	12	10	50
4"	10	8	12	12	10	100
5"	10	8	12	12	10	100
6"	10	8	12	12	10	100
7"	10	8	12	12	10	100
8"	10	8	12	12	10	100
9"	10	8	12	12	10	100
10"	10	8	12	12	10	100
12"	10	8	12	12	10	100
14"	10	8	12	12	10	100
16"	10	8	12	12	10	100
18"	10	8	12	12	10	100
20"	10	8	12	12	10	100
22"	10	8	12	12	10	100
24"	10	8	12	12	10	100
26"	10	8	12	12	12	100
28"	10	8	12	12	12	100
30"	10	8	12	12	12	100
32"	10	8	12	12	12	100
34"	10	8	12	12	12	100
36"	10	8	12	12	12	100

Table 7: Support and Guide Spacing for Model DS & DSLS. Dimensions are in feet

SUPPORT AND GUIDE SPACING FOR MODEL DSD & DSID & DSLD						
Inside diameter	MVS		MHS	MDE	H	S
	Interior	Exterior				
3"	10	8	12	12	10	50
4"	10	8	12	12	10	50
5"	10	8	12	12	10	50
6"	10	8	12	12	10	50
7"	10	8	12	12	10	50
8"	10	8	12	12	10	50
9"	10	8	12	12	10	50
10"	10	8	12	12	10	50
12"	10	8	12	12	10	50
14"	10	8	12	12	10	50
16"	10	8	12	12	10	50
18"	10	8	12	12	10	50
20"	10	8	12	12	10	50
22"	10	8	12	12	10	50
24"	10	8	12	12	10	50
26"	10	8	12	12	12	50
28"	10	8	12	12	12	50
30"	10	8	12	12	12	50
32"	10	8	12	12	12	50
34"	10	8	12	12	12	50
36"	10	8	12	12	12	50

Table 8: Support and Guide Spacing for Model DSD, DSID & DSLD. Dimensions are in feet

MVS : Maximum Vertical Spacing between Guides/Supports
MHS: Maximum Horizontal Spacing between Guides/Supports
MDE: Maximum Distance between Elbows
H: Maximum Freestanding Height above the Roof
S: Maximum Suspended Length

HORIZONTAL INSTALLATION REQUIREMENTS

- When venting through a sidewall, terminate the system not less than 12" (.3m) above the ground and above the snow line in geographical areas where snow accumulates. The termination area must be kept clear of snow and ice at all times. See **Figure 1**.
- Terminate the system at least 7' (2.1m) above a public walkway or driveway, no less than 6' (1.8m) from the combustion air intake of any appliance or 3' (.9m) from any other building opening, gas utility meter, service regulator or the like. Less distance is permitted if specified in the appliance's installation instructions. It also shall terminate at least 3' (.9M) above any forced air inlet within 10' (3.1m) and shall terminate at least 4' (1.2m) below, 4' horizontally from, or 1' (.3m) above any door, window, or gravity air inlet into any building as provided in the National Fuel Gas Code ANSI Z223.1 and NFPA 54. See **Figure 1**. Proper judgment may require greater distances depending on the side of the equipment installed or to allow for snow drifting or falling from falling from overhead roofs or trees. The termination should be far enough away from trees, shrubs, or decorative items to prevent damage.
- The total horizontal vent length from the appliance flue collar to the outside termination shall be in accordance with the appliance manufacturer's instructions.

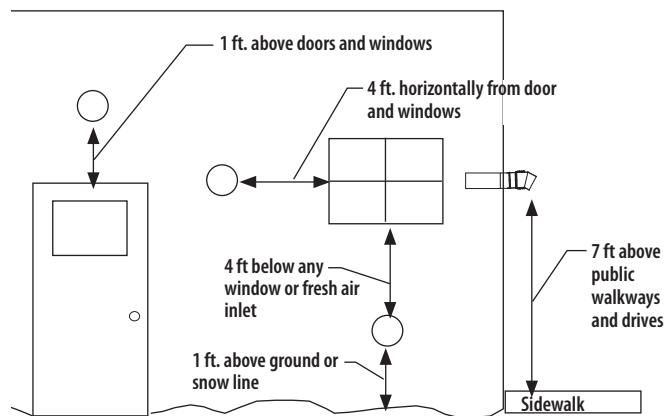


Figure 1 - Horizontal Termination Requirements

VERTICAL INSTALLATION REQUIREMENTS

1. The vent system must terminate at least 3 feet above the roof line and at least 2 feet higher than any portion of the building within 10 feet. See **Figure 2**. This limitation can be removed if an engineering analysis demonstrates normal and safe operation of appliance.
2. When terminated at a height of more than 10 feet, the stack must be supported by a Guy Section.
3. The vent system must terminate with one of the DuraSeal® terminations.

Except;

- a) Category I appliances (natural draft) must use a Rain Cap. It is optional on Category II. This limitation can be removed if an engineering analysis demonstrates normal and safe operation of appliance.
 - b) Vent systems without provisions for draining rain water must use a Rain Cap.
 - c) Terminations or approved mechanical vent devices specified or provided by the appliance manufacturer are permitted.
4. The total continuous distance of the vent system from the appliance flue collar to the termination shall not exceed that specified in the appliance manufacturer's installation instructions. When venting natural draft appliances the termination must be at least 5 feet above the topmost draft hood. Otherwise a listed mechanical draft inducing device is required. This limitation can be removed if an engineering analysis demonstrates normal and safe operation of appliance.
 5. In general, systems installed in cold climates perform best, and condensation is reduced, when the system is fully enclosed by some part of the building structure or by using insulated DSID venting system.
 6. In cold climates do not install a condensate drain on the exterior of the building. Doing so may result in dangerous icy conditions on surfaces near the drain and may cause damage to the vent system and/or the building exterior. DuraVent will NOT be held liable for any personal injury or property damage due to any formation of ice.
 7. Vertical supports are required after every transition to vertical. Vertical supports are also required after every offset elbow.
 8. Unless DuraSeal is installed in a fire rated shaft, a roof thimble and support is required when penetration fire rated floors, walls or ceilings.

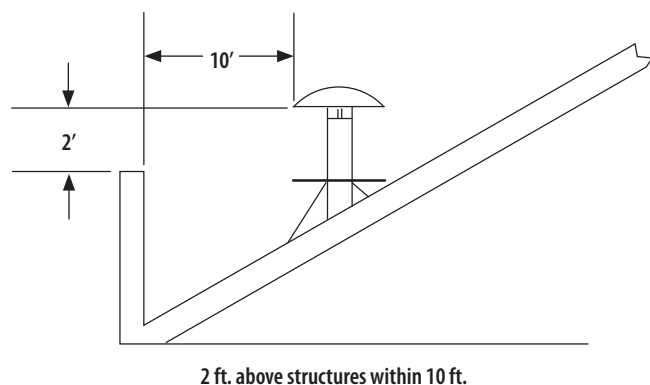


Figure 2- Vertical Installation Requirements

ROOF / FLOOR PENETRATION

1. A roof thimble (RT) or roof thimble insulated (RTI) for cold climate must be installed every time the vent system passes through a floor or roof.
2. Prepare the roof / floor by cutting a square opening. See **Table 9, 10 & 11**.
3. Install the roof thimble. You may cut the radiation sleeve if it is too long. See **Figure 3**.
4. For roof installation, install a flashing.

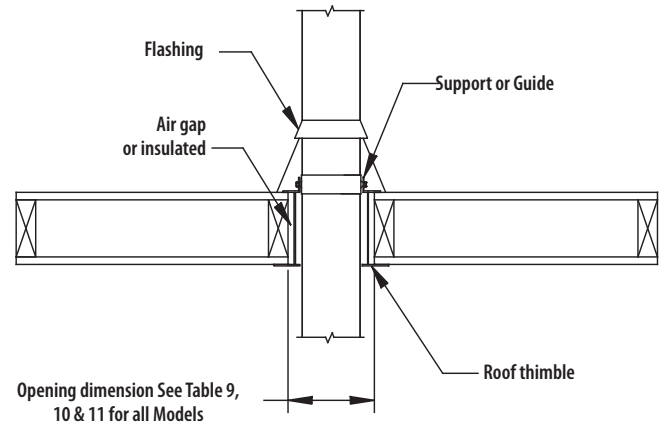


Figure 3 - Roof penetration

MAINTAIN PROPER SLOPE

- Install with a continuous 1/4" per foot (minimum) slope, as is required by the National Fuel Gas Code for all gas-fired appliances.
- Vent systems for condensing appliances must have a continuous 1/4" per foot (minimum) slope toward the appliance or a condensate drain. Always check the appliance manufacturer's instructions for proper drain requirements.
- DuraSeal® offers a range of tees and elbows that are built incorporating a 2 degree slope, we recommend that you use these to generate your slope.
- Some appliances require the venting system to be sloped toward the horizontal termination.
- Remember, if you raise the appliance or lower the ceiling you must adjust the slope of the vent to maintain the 1/4" per foot minimum. See **Figure 5 & 26**.

WALL PENETRATION

1. Prior to installation, determine proper location of wall thimble (WT) or wall thimble insulated (WTI) so that a minimum slope of 1/4" (6mm) per foot is maintained in the horizontal section of vent to ensure proper flow of condensation.
2. Prepare the wall by cutting a square opening. See **Table 9, 10 & 11** for opening for all Models.
3. Install the wall thimble by inserting the larger of the two parts on the appliance (interior side). See **Figure 4**.
4. Next, apply a bead of sealant around the edges of the exterior (smaller of the two parts) wall thimble component. Then install this part of the wall thimble by inserting the smaller collar into the other component from the previous step.

NOTE: The two horizontal cylinders of the thimble must engage a minimum of two inches.

5. Fasten both sides of the wall thimble using screws or nails.
6. Once the thimble is installed, DuraSeal vent pipe can be inserted into the thimble.
7. Close the gap between the thimble and the vent by installing the two half plate and fasten it using screws or nails.
8. Install horizontal termination to complete the assembly.
9. Once assembly is completed, apply a bead of high-temp sealant around the pipe and the exterior two half plates of the thimble to protect against weather.
10. The air gap is filled with insulation when using the insulated wall thimble (WTI).

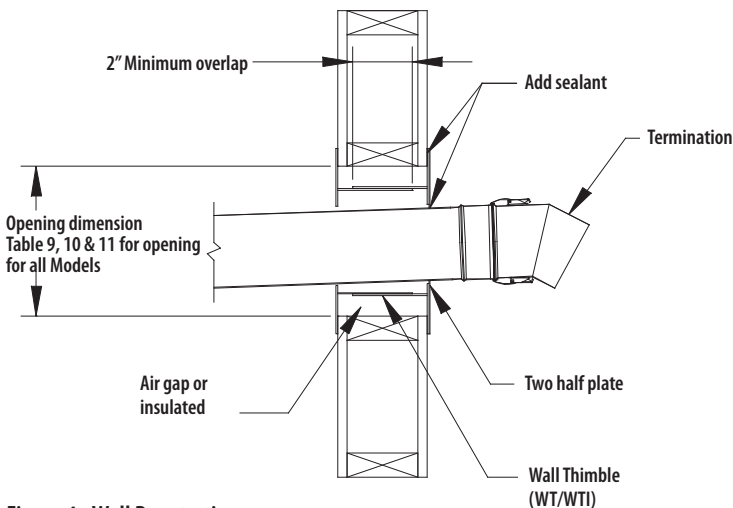


Figure 4 - Wall Penetration

OPENING DIMENSIONS FOR WALL/ROOF PENETRATION FOR MODEL DS/DSLS				
Inside Diameter	Wall Thimble (WT)	Wall Thimble Insulated (WTI)	Roof Thimble (RT)	Roof Thimble Insulated (RTI)
3"	8x8	9x9	7x7	11x11
4"	9 x 9	10 x 10	8 x 8	12 x 12
5"	10 x 10	11 x 11	9 x 9	13 x 13
6"	11 x 11	12 x 12	10 x 10	14 x 14
7"	12 x 12	13 x 13	11 x 11	15 x 15
8"	13 x 13	14 x 14	12 x 12	16 x 16
9"	14 x 14	15 x 15	13 x 13	17 x 17
10"	15 x 15	16 x 16	14 x 14	18 x 18
12"	17 x 17	18 x 18	16 x 16	20 x 20
14"	22 x 22	22 x 22	22 x 22	22 x 22
16"	24 x 24	24 x 24	24 x 24	24 x 24
18"	26 x 26	26 x 26	26 x 26	26 x 26
20"	28 x 28	28 x 28	28 x 28	28 x 28
22"	30 x 30	30 x 30	30 x 30	30 x 30
24"	32 x 32	32 x 32	32 x 32	32 x 32
26"	38 x 38	38 x 38	38 x 38	38 x 38
28"	40 x 40	40 x 40	40 x 40	40 x 40
30"	42 x 42	42 x 42	42 x 42	42 x 42
32"	46 x 46	44 x 44	44 x 44	44 x 44
34"	46 x 46	46 x 46	46 x 46	46 x 46
36"	48 x 48	48 x 48	48 x 48	48 x 48

Table 9: Opening Dimensions for Model DS & DSLS. Dimensions are in inches.

OPENING DIMENSIONS FOR WALL/ROOF PENETRATION FOR MODEL DSID				
Inside Diameter	Wall Thimble (WT)	Wall Thimble Insulated (WTI)	Roof Thimble (RT)	Roof Thimble Insulated (RTI)
3"	10x10	11x11	7x7	11x11
4"	13 x 13	14 x 14	10 x 10	14 x 14
5"	14 x 14	15 x 15	11 x 11	15 x 15
6"	15 x 15	16 x 16	12 x 12	16 x 16
7"	16 x 16	17 x 17	13 x 13	17 x 17
8"	17 x 17	18 x 18	14 x 14	18 x 18
9"	N/A	N/A	N/A	N/A
10"	19 x 19	20 x 20	16 x 16	20 x 20
12"	22 x 22	22 x 22	18 x 18	22 x 22
14"	24 x 24	24 x 24	20 x 20	24 x 24
16"	26 x 26	26 x 26	22 x 22	26 x 26
18"	28 x 28	28 x 28	24 x 24	28 x 28
20"	30 x 30	30 x 30	26 x 26	30 x 30
22"	32 x 32	32 x 32	28 x 28	32 x 32
24"	N/A	N/A	N/A	N/A

Table 10: Opening Dimensions for Model DSID. Dimensions are in inches.

OPENING DIMENSIONS FOR WALL/ROOF PENETRATION FOR MODEL DSD/DSLD				
Inside Diameter	Wall Thimble (WT)	Wall Thimble Insulated (WTI)	Roof Thimble (RT)	Roof Thimble Insulated (RTI)
3"	12x12	13x13	9x9	13x13
4"	11 x 11	12 x 12	8 x 8	12 x 12
5"	12 x 12	13 x 13	9 x 9	13 x 13
6"	13 x 13	14 x 14	10 x 10	14 x 14
7"	14 x 14	15 x 15	11 x 11	15 x 15
8"	15 x 15	16 x 16	12 x 12	16 x 16
9"	16 x 16	17 x 17	13 x 13	17 x 17
10"	17 x 17	18 x 18	14 x 14	18 x 18
12"	19 x 19	20 x 20	16 x 16	20 x 20
14"	22 x 22	22 x 22	18 x 18	22 x 22
16"	24 x 24	24 x 24	20 x 20	24 x 24
18"	26 x 26	26 x 26	22 x 22	26 x 26
20"	28 x 28	28 x 28	24 x 24	28 x 28
22"	30 x 30	30 x 30	26 x 26	30 x 30
24"	32 x 32	32 x 32	28 x 28	32 x 32
26"	40 X 40	40 X 40	32 x 32	32 X 32
28"	42 X42	42 X 42	34 x 34	34 X 34
30"	44 X 44	44 X 44	36 x 36	36 X 36
32"	46 X 46	46 X 46	38 x 38	38 X 38
34"	48 X 48	48 X 48	40 x 40	40 X 40
36"	50 X 50	50 X 50	42 x 42	42 X 42

Table 11: Opening Dimensions for Model DSD & DSLD.
Dimensions are in inches.

CONDENSATE DRAINS

When an internal condensate drain is NOT part of the appliance:

1. A Drain length (DL) or a Tee with a drain tee cap (DTC) is strongly recommended. Install this drain as close as possible to the appliance flue collar.
2. A condensate drain is required for every 30 feet of horizontal vent and at the bottom of a vertical stack.
3. Use the Drain length for a straight horizontal run. Rotate the fitting so that the drain tube is as vertical as possible.
4. Use a Tee at a transition from horizontal to vertical, and attach the Drain Tee Cap to the appropriate branch of the tee.
5. A condensate drain tube kit is available to direct the condensate to an appropriate location. A trap loop must be formed into the drain hose and must be a diameter that is at least four times the appliance's rated stack pressure in inches of water column or minimum 3 inches. Secure the loop with a cable tie.
6. Flue gas condensate can have a low (3 to 5) PH level, follow all local and national codes and regulations for the draining of acidic condensate.
7. In cold climate, do not install a condensate drain on the exterior of the building. Doing so may result in dangerous icy conditions on surfaces near the drain and may cause damage to the vent system and the building exterior. DuraVent™ will NOT be held liable for any injury or property damage due to formation of ice.

SECTION B

SPECIFIC INFORMATION MODELS DS, DSD AND DSID (3" TO 24")

TYPICAL INSTALLATION (DS-DSD-DSID)

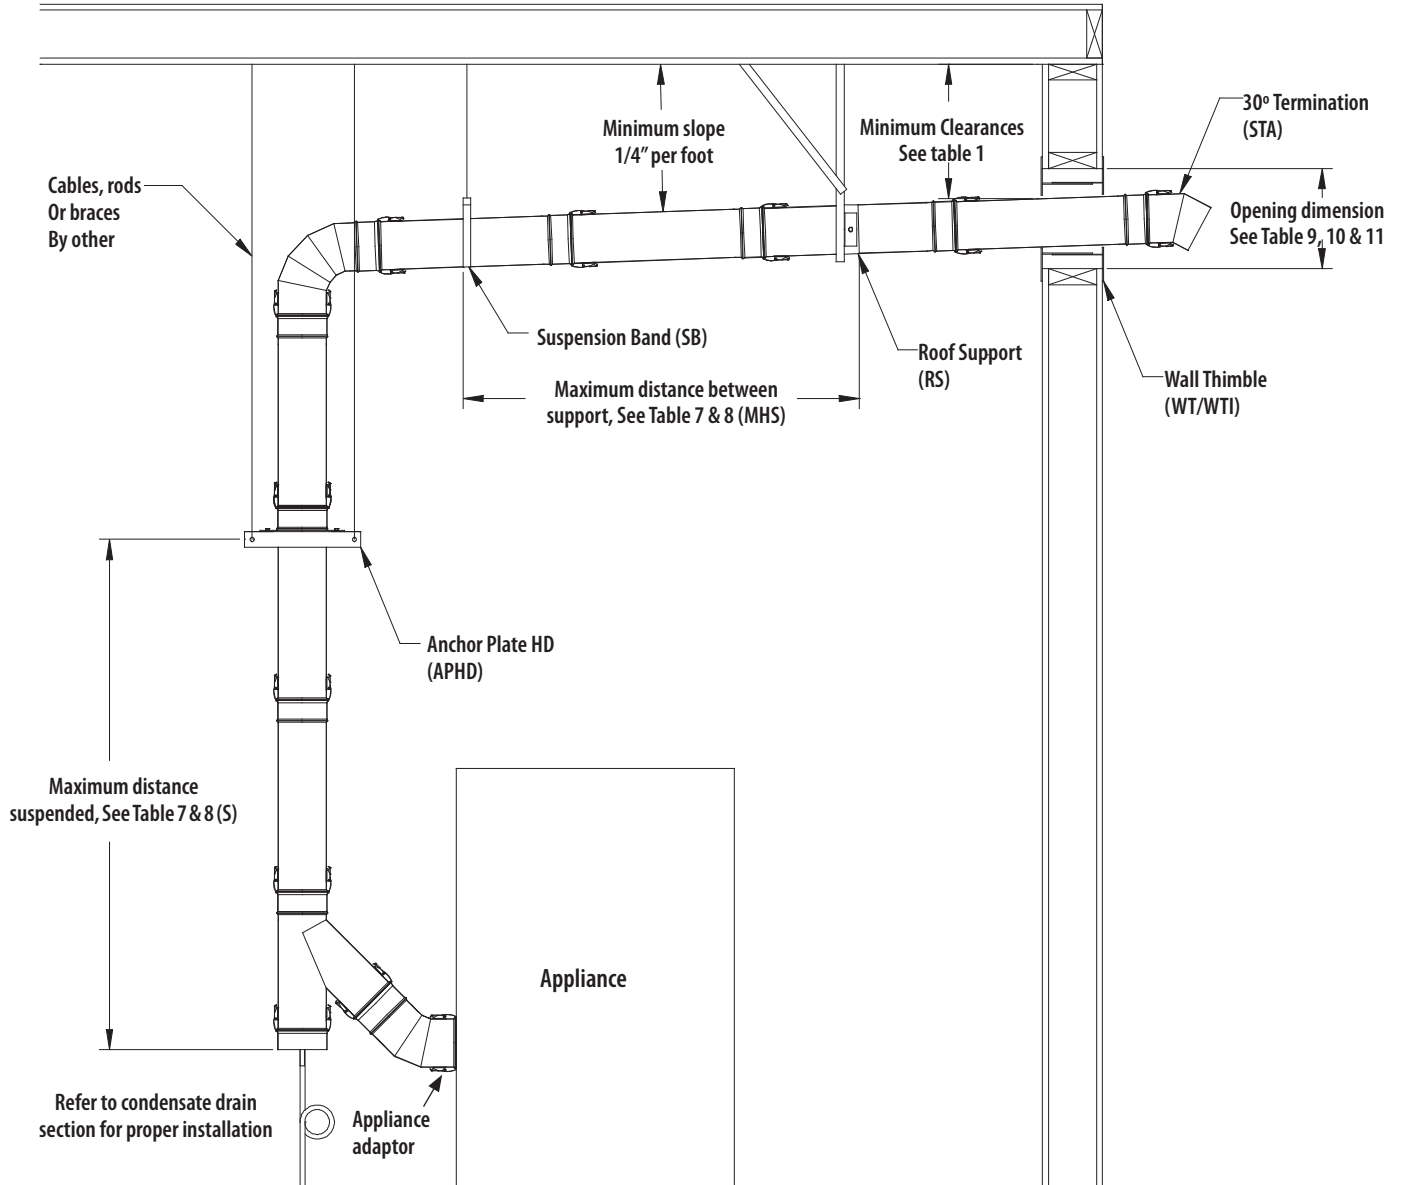


Figure 5- Horizontal

TYPICAL INSTALLATION (DS-DSD-DSID) (3" to 24")

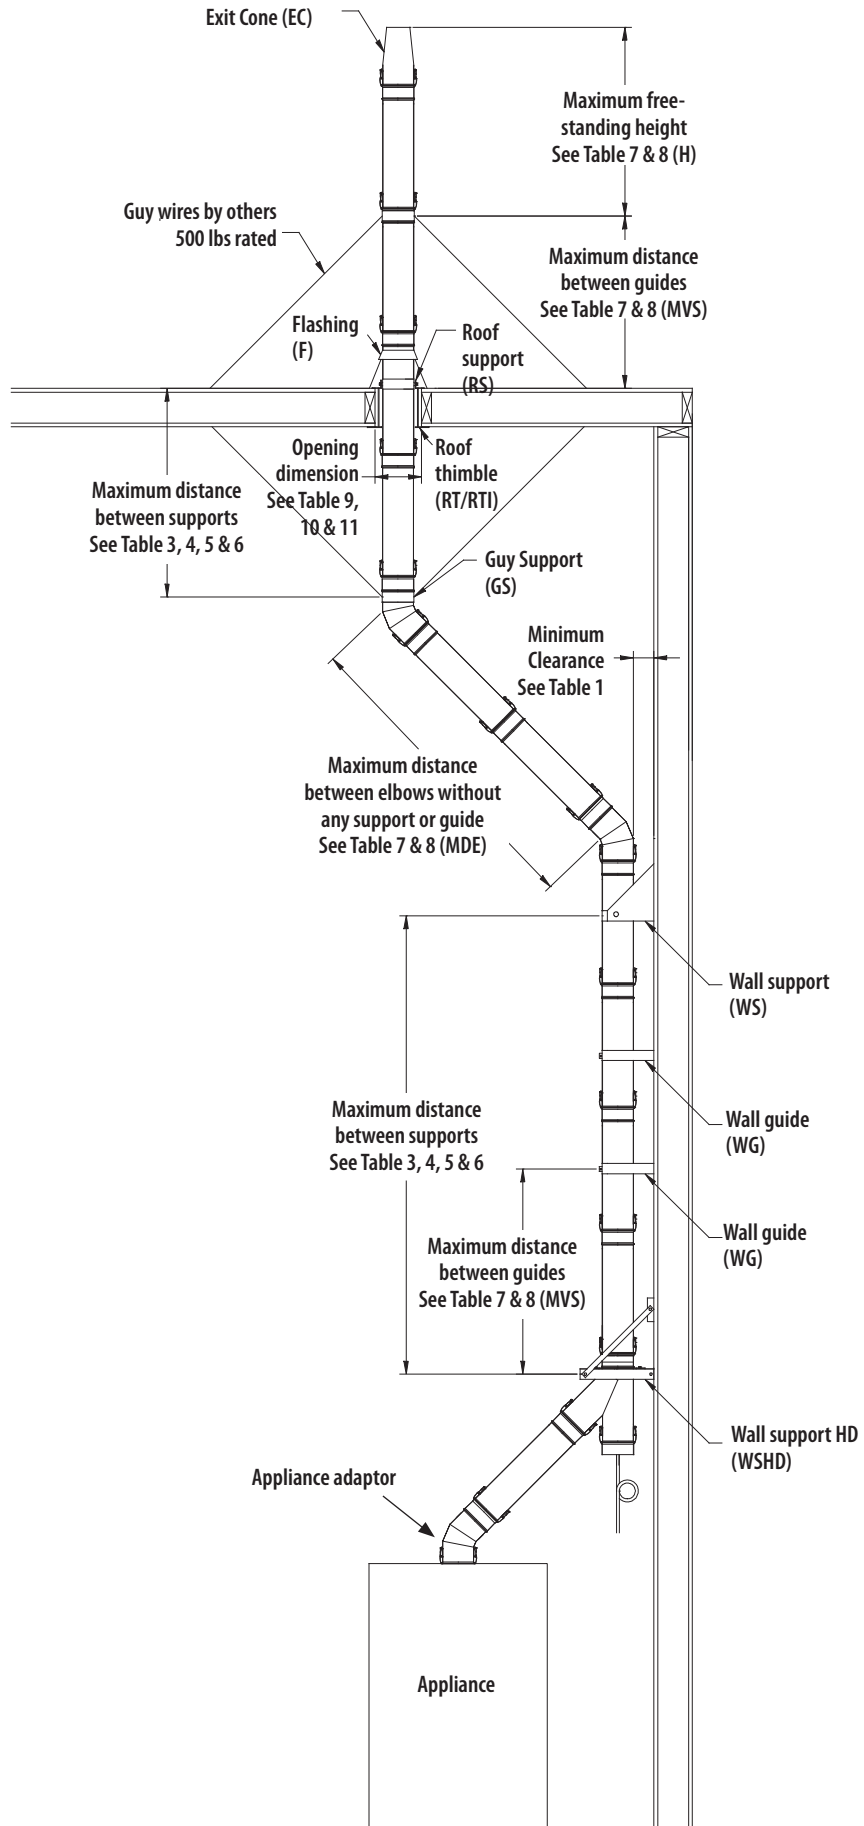


Figure 6 - Vertical

CHIMNEY AND FITTING JOINT ASSEMBLY (DS-DSD-DSID)

(See Page 21 for DSLS-DSLSD)

All components have a male and female end, the male end has the gasket. The installation orientation is indicated on the labeling of each chimney section with an arrow. The arrow indicated the direction of the flow.

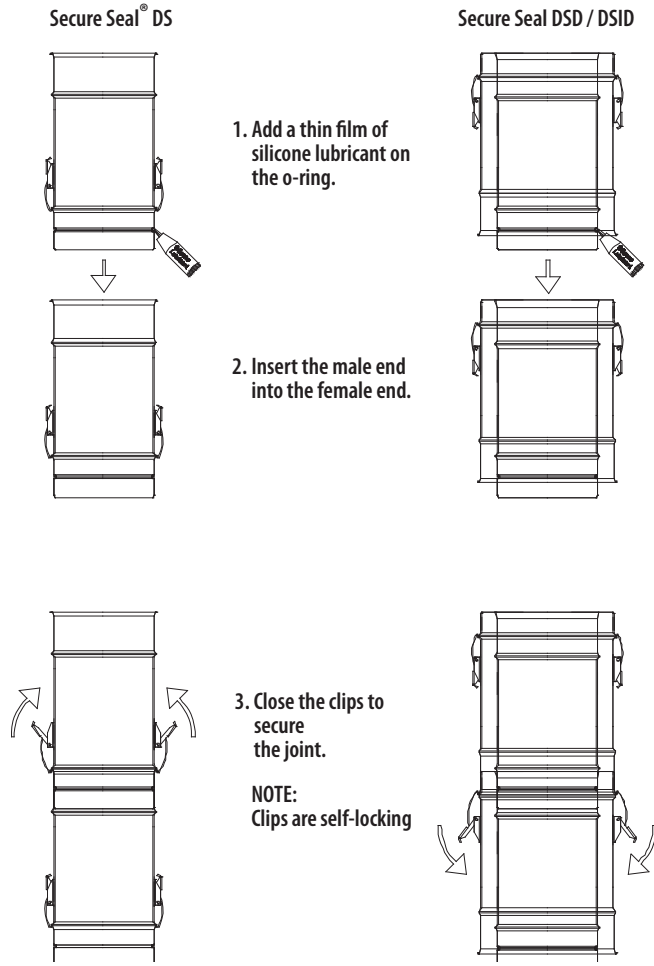


Figure 7 - Joint assembly steps

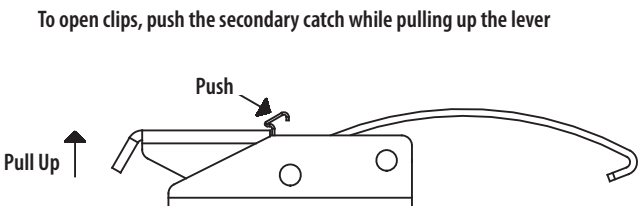


Figure 8 - Opening clips

ASSEMBLY JOINT DS/DSD/DSID LUBE REQUIREMENT	
Inside Diameter	Qty (oz)
3"	0.1
4"	0.1
5"	0.1
6"	0.1
7"	0.1
8"	0.2
9"	0.2
10"	0.2
12"	0.3
14"	0.3
16"	0.3
18"	0.4
20"	0.4
22"	0.5
24"	0.5

Table 12

*Important Notes: (DS-DSD-DSID ONLY)

1. For Anchor Plate (AP) / Anchor Plate Heavy Duty (APHD) / Wall Support Heavy Duty (WSHD), the support must be installed below a bead. See **Figure 9**.
2. For Wall Support (WS) / Roof Support (RS), the support can be installed anywhere on the part.
3. For Anchor plate length, the support is already integrated to a length. Directly attached to the building structure or supported by non combustible structural elements (not included). No other installation is required than the standard installation for a regular length.

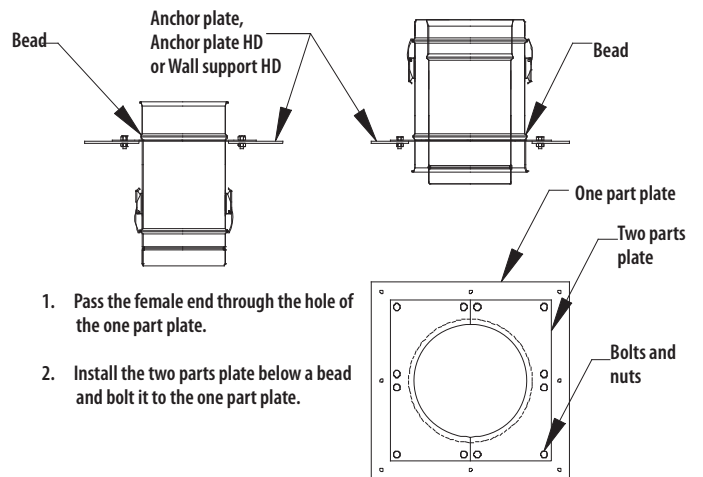


Figure 9 - Position of Support

ADJUSTABLE LENGTH (DS, DSD, DSID)

For installations that requires non-standard vent lengths, DuraSeal® Adjustable Length (AL) should be used.


NOTE: The adjustable length is a non load bearing part. A support must be used after it to take the load of the sections above.

NOTE: The inner conduit may be cut to desired length to limit interference with downstream part. See **Figure 10**

DuraSeal DS

1. Keep a play about 1/8" to 1/4" to allow thermal expansion

2. Apply a 1/8" to 1/4" bead (may vary) of Viton caulking to fill the gap between the adjustable length inner wall and the female end of the standard part. Please allow 24-36 hours for Viton to cure.

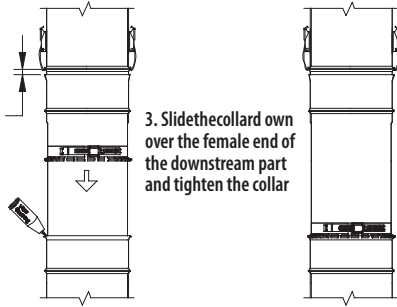


3. Slide the collar down over the female end of the downstream part and tighten the collar

DuraSeal DSD

1. Keep a play about 1/8" to 1/4" to allow thermal expansion

2. Apply a 1/8" to 1/4" bead (may vary) of Viton caulking to fill the gap between the adjustable length inner wall and the female end of the standard part. Please allow 24-36 hours for Viton to cure."

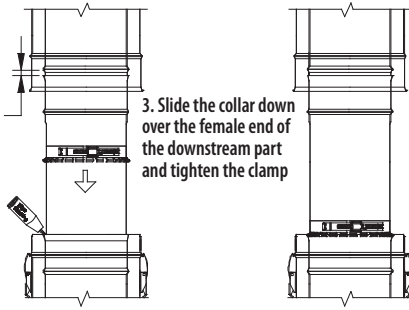

3. Slide the collar down over the female end of the downstream part and tighten the clamp

4. Install the outer shell over end of downstream part and under the end of upstream part and tighten the clamps. Need to cut outer shell to correct length.

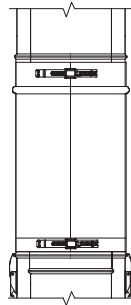


Figure 10 - Adjustable length installation steps

ADJUSTABLE LENGTH DS/DSD/DSID CAULKING REQUIREMENT	
Inside diameter	Qty(oz)
3"	0.2
4"	0.3
5"	0.4
6"	0.5
7"	0.6
8"	0.7
9"	0.8
10"	0.9
12"	1.0
14"	1.2
16"	1.4
18"	1.5
20"	1.7
22"	1.9
24"	2.1

Table 13

TELESCOPIC ADJUSTABLE LENGTH (DS & DSD Only)

2 models are available in DS and DSD :

- DS or DSDØLAT20 that provide an adjustability range from 14" to 20"
- DS or DSDØLAT32 that provide an adjustability range from 22" to 32"

NOTE: This is not load bearing component. If installed in a vertical position, always install a support above it to support the load from the next sections.

Installation steps:

- 1 - Install the 2 O-rings provided in their respective groove;
- 2 - Apply a thin film of lubricant on both O-rings;
- 3 - Insert the sections into each other until desired length is achieved.
DS: Make sure that both O-rings penetrate into the section below
DSD: Make sure the outside casing overlaps

DuraSeal DS

DuraSeal DSD

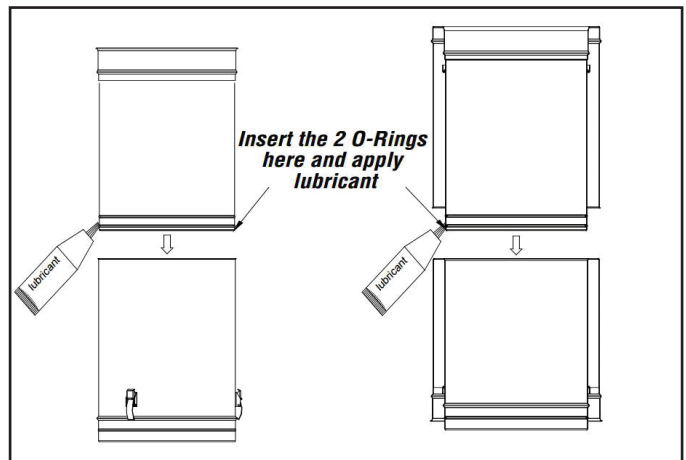


Figure 11 - Opening clips

INSTALLING DuraSeal® AS A LINER IN A MASONRY CHIMNEY OR AS A LINER IN AN EXISTING VENT (DS - DSD - DSID only)

* Stainless Steel Wire Rope (by others) is to be used to hang the vent system from the top of the masonry chimney or from the top of the existing vent.

- The stainless wire rope is attached to the Guy Support Band and is secured with cable clamps (by others).
- The Stainless Steel Wire Rope is secured in a similar manner to the top platform of the masonry chimney or existing vent.
- Use the appropriate size of Stainless Steel Wire Rope to accommodate the required total loads of the vent system.

It may be necessary to fabricate a platform (at top of chimney/vent - by others).

Consult DuraVent for guidelines.

DO NOT USE GALVANIZED WIRE ROPE.

Note: When installed as a liner in a masonry chimney or to reline an existing vent no other appliance can be vented into the same chimney or vent.

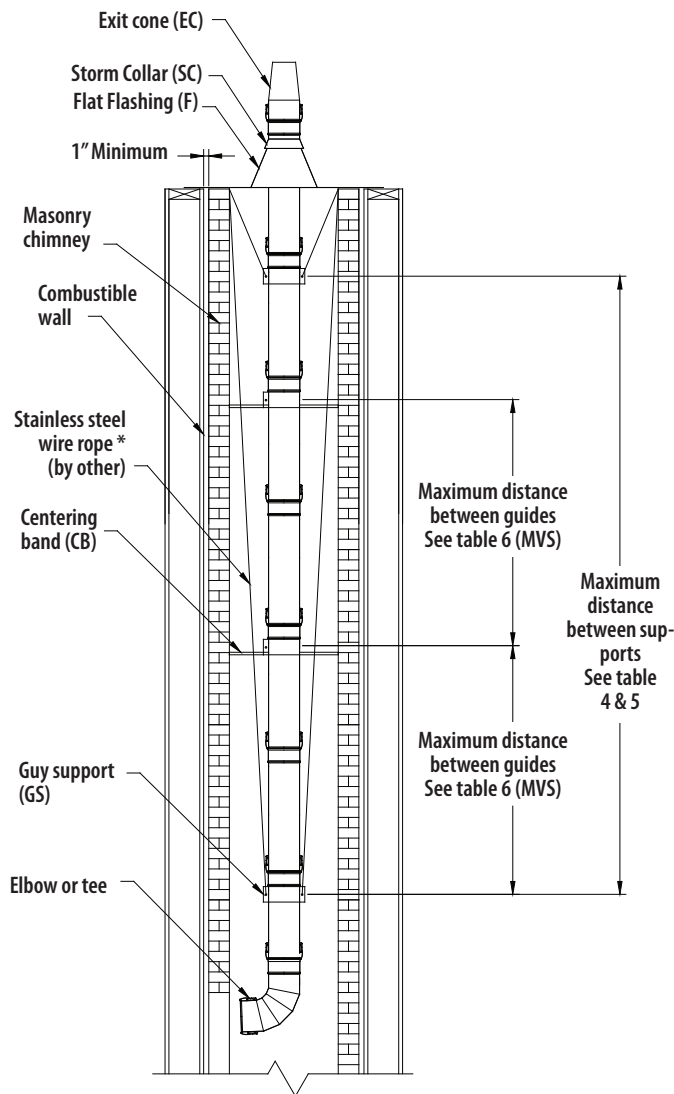


Figure 12 - Installing DuraSeal as a liner

DuraSeal FLEX FOR SS ONLY

***IMPORTANT NOTE**

When installing DuraSeal Flex, the direction of exhaust flow is always from the appliance. There is an arrow printed on each section of liner and component that will point in the direction of the exhaust gas. If the inner liner is installed correctly the proper direction can be determined by running your fingernails up the inside wall of the liner. If the direction is correct, your nails will catch at the seams of the inner wall. If it is incorrect, your nails will slide smoothly across the inner surface.

Description of the DuraFlex adapters

I- The male adapter is used to connect a rigid duct to a flexible liner. It has latches and a Viton Black O-ring (Figure 13). It is installed at the bottom of the flexible length.

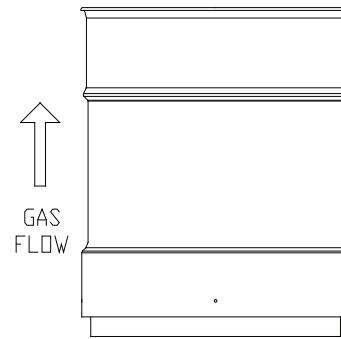


Figure 13 - DuraSeal Male adapter

II- The Flex-Flex adapter is used to connect two flexible liners together. Its upper side is a single wall with 4 screw holes and its lower side has two walls whose outer wall also has 4 screw holes (**Figure 14**). It is installed between two flexible liners, usually halfway through the chimney.

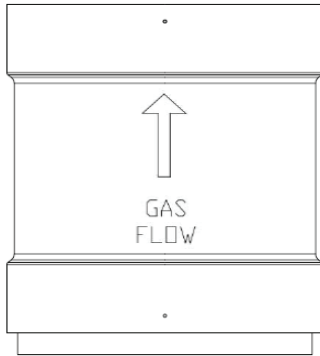


Figure 14 - DuraSeal FLEX-FLEX adapter

III- The female adapter is used to connect the flexible length to a rigid duct. Its upper side reversed edge, and the lower side has two side walls, which the outer wall has screw holes (**Figure 15**). It is installed on the top of the flexible length.

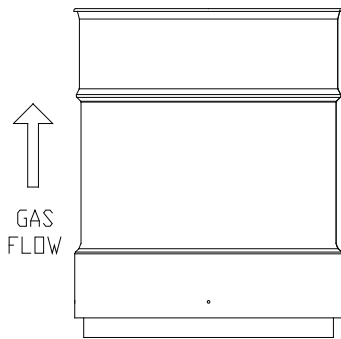


Figure 15 - DuraSeal Female adapter

I. Assembly steps for the Flex-Flex adapter with the flexible liner

1. Before official installation

1.1. If cutting the liner on the field is required, make sure the cut is square. Make a marker line on both ends of the liner at 1 5/8" from each end. That mark will act as a reference point when the adapters are fully seated onto the flex liner. (**Figure 16**).

1.2. To make sure that everything is airtight before putting the sealant between both tubes, do a dry fit test by pushing the liner into the adapter until it reaches the bottom of the flare between the inner wall and the outer wall, then remove it (**Figure 17**).

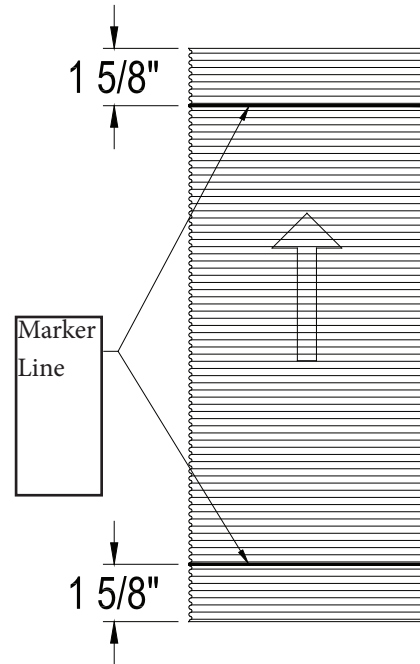


Figure 16 - DuraSeal Flex marker line

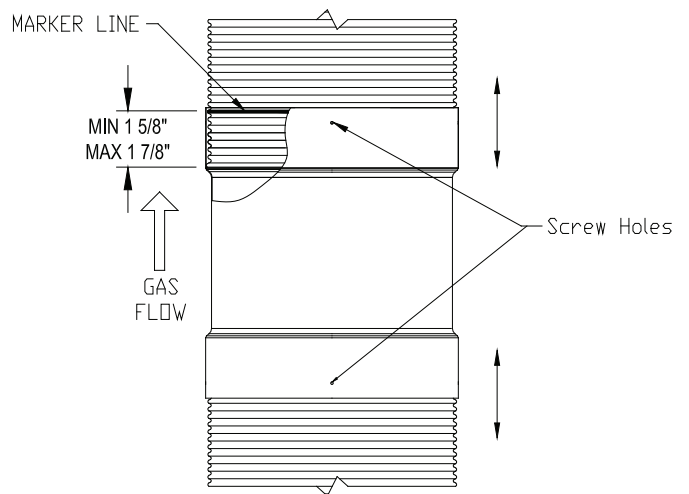


Figure 17 - DuraSeal Flex dry fit test

Official installation of the upper side of the adapter on the flexible liner

- 2.1. Add a bead of Viton® caulking (resistance to condensate) all around inside the adapter on the beginning of the flare. Add another bead of Viton® caulking all around the outside of the flexible liner at 3/4" from the edge (Figure 18).

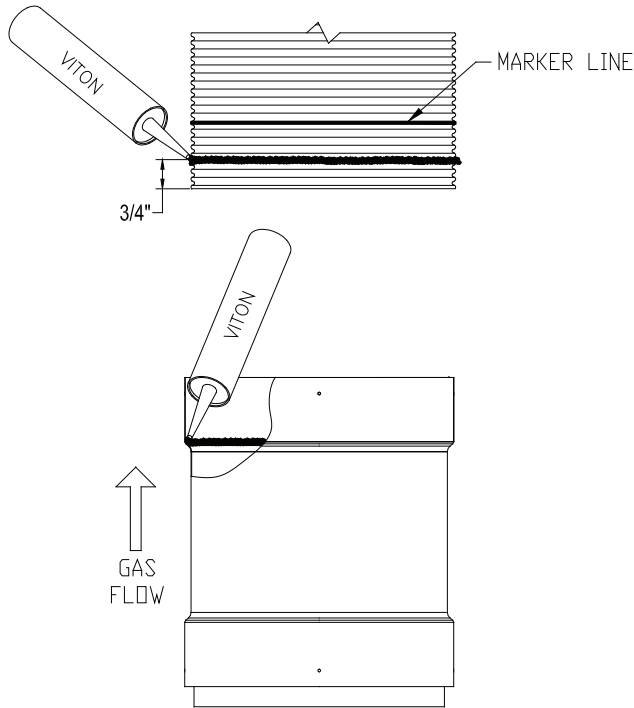


Figure 18 -DuraSeal Flex Vi ton• caulking

- 2.2. Push the adapter on the liner all the way in, until you can't see the mark made on the flexible liner earlier (Figure 19). Make sure that the Viton® caulking is sealed well at the joint inside the adaptor by verifying inside the adaptor.

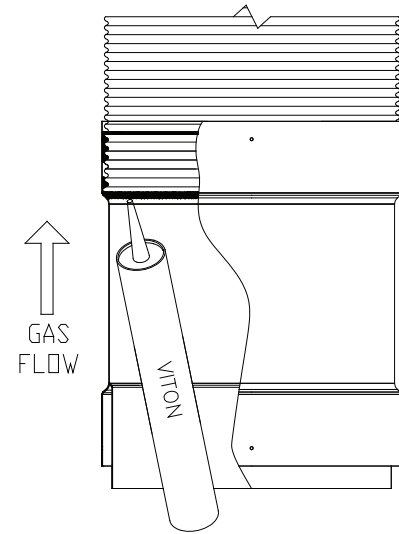


Figure 19-DuraSeal Flex assembly

- 2.3. Add a bead of the S-650 red caulking all around the outer junction of the adapter and the flexible liner to make sure everything is well sealed. Also add over the screw holes (Figure 20).

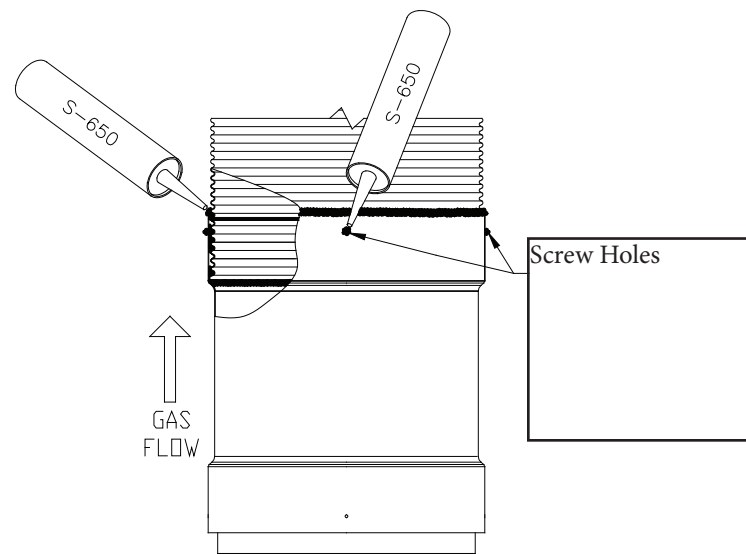


Figure 20- DuraSeal Flex S-650 caulking

- 2.4. Install screws in the screw hole and tighten.
- 2.5. Add the red S-650 caulking over the screws (**Figure 21**).

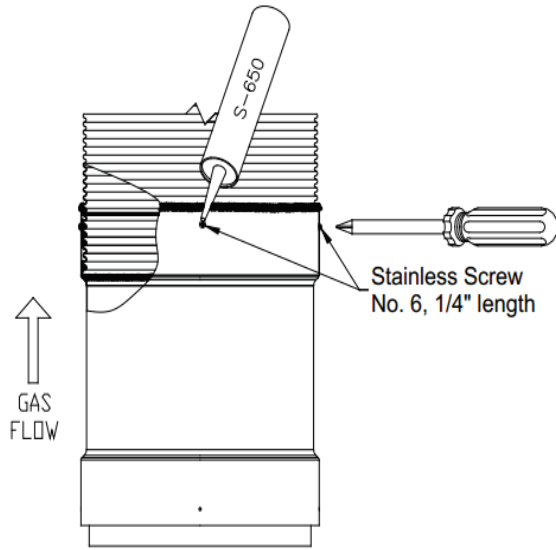


Figure 21 -DuraSeal Flex screws

- 3.3. Push the adapter on the liner all the way in, until you can't see the mark made on the flexible liner earlier. Add a bead of the S-650 red caulking all around the outer junction of the adapter and the flexible liner to make sure everything is well sealed. Also add over the screw holes (**Figure 23**).

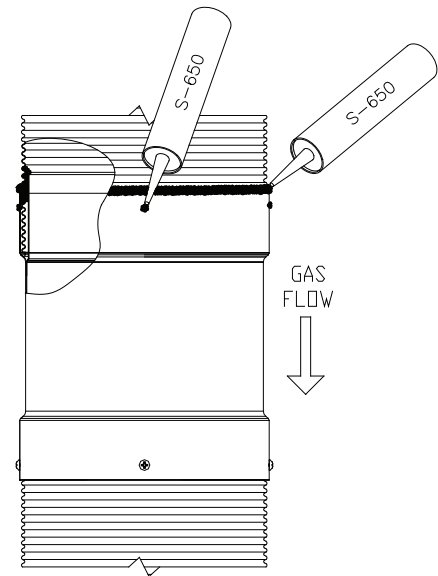


Figure 23 -DuraSeal Flex S-650 caulking

3. Official installation of the lower side of the adapter on the flexible liner

- 3.1. Add a bead of Viton® caulking (resistance to condensate) all around the adapter between both tubes of the adapter. Just make sure that the gap is well filled about 1/4" of Viton®.
- 3.2. Add another bead of Viton® caulking at 1/2" from the edge of the flexible liner all around the inner side of it (**Figure 22**).

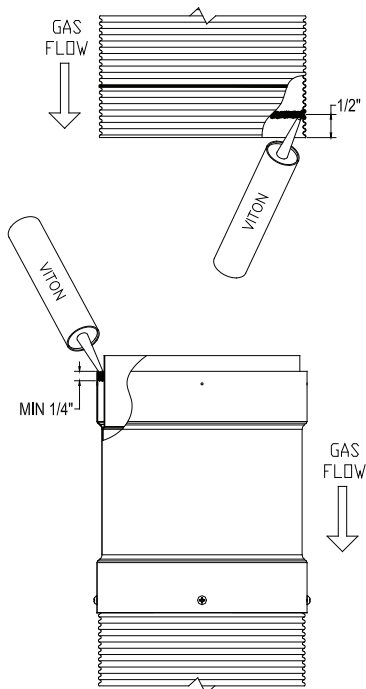


Figure 22 -DuraSeal Flex Viton® caulking

- 3.4. Install screws in the screw hole and tighten.
- 3.5. Add the red S-650 caulking over the screws (**Figure 24**).

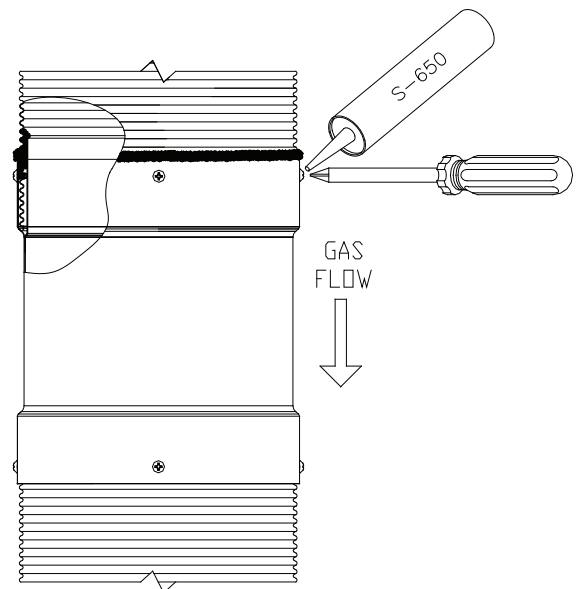


Figure 24 - DuraSeal Flex screws

- II. Assembly steps for the MALE adapter with the flexible liner
Do steps 1.1 to 1.2, and 2.1 to 2.5 of the upper side of the FLEX-FLEX adaptor.
- III. Assembly steps for the FEMALE adapter with the flexible liner
Do steps 1.1 to 1.2, and 3.1 to 3.5 of the lower side of the FLEX-FLEX adaptor.

BASIC DuraSeal FLEX LINER INSTALLATION

- 1- Determine the required location and opening in the masonry chimney. For a basic DuraSeal Flex installation the opening must be large enough for the mortar sleeve and Male Flex Adapter and the DuraSeal Flex to easily pass through. If a Tee application is necessary, a larger hole may be required.
- 2- Make sure the DuraSeal Flex is supported at the bottom of the chimney. Refer to **Figure 12** for guiding and support installation in the masonry chimney.
- 3- The DuraSeal Flex liner must be installed from the top of the masonry chimney. To prevent damage, one person should feed the liner through the chimney and another person should pull the liner from the bottom. To ease the installation, you can attach a rope to the DuraSeal Flex liner above the Male Flex Adapter. Doing this will reduce the chance of breaking the seal between the DuraSeal Flex and the Male Flex Adapter.
- 4- The DuraSeal Flex must stay within the masonry chimney; however the Elbow or other DuraSeal components will extend beyond the masonry chimney. (**Figure 25**)
- 5- It is strongly recommended to use a drain between the Male Flex Adapter and the appliance (refer to Condensate Drains section).

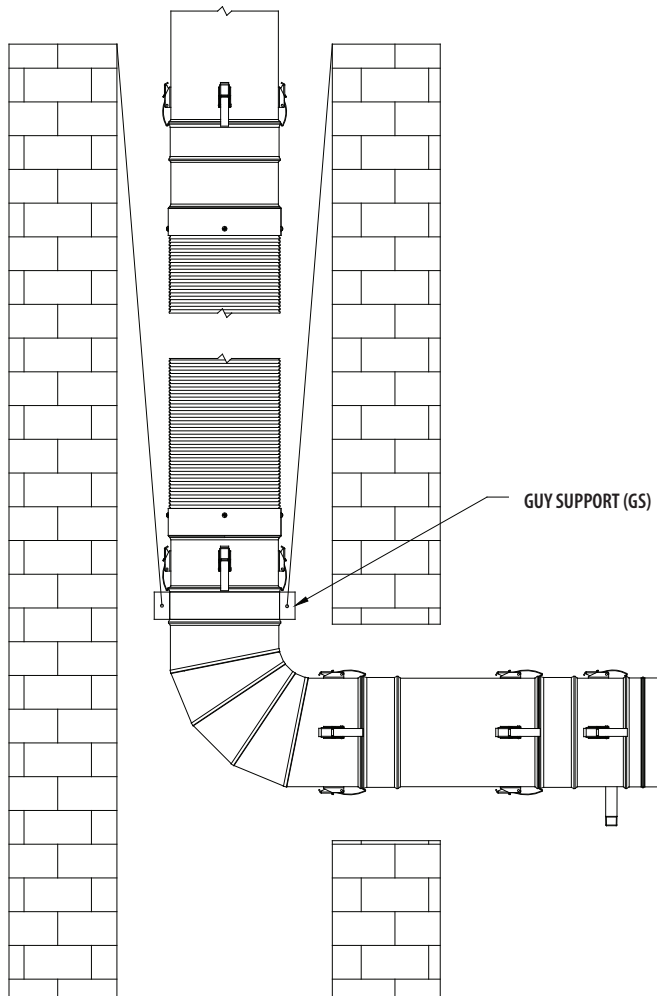


Figure 25- DuraSeal Flex Adapter - Elbow in masonry

SECTION C

SPECIFIC INFORMATION MODELS DSLS & DSLD (26" TO 36")

TYPICAL INSTALLATION FOR DSLS & DSLD

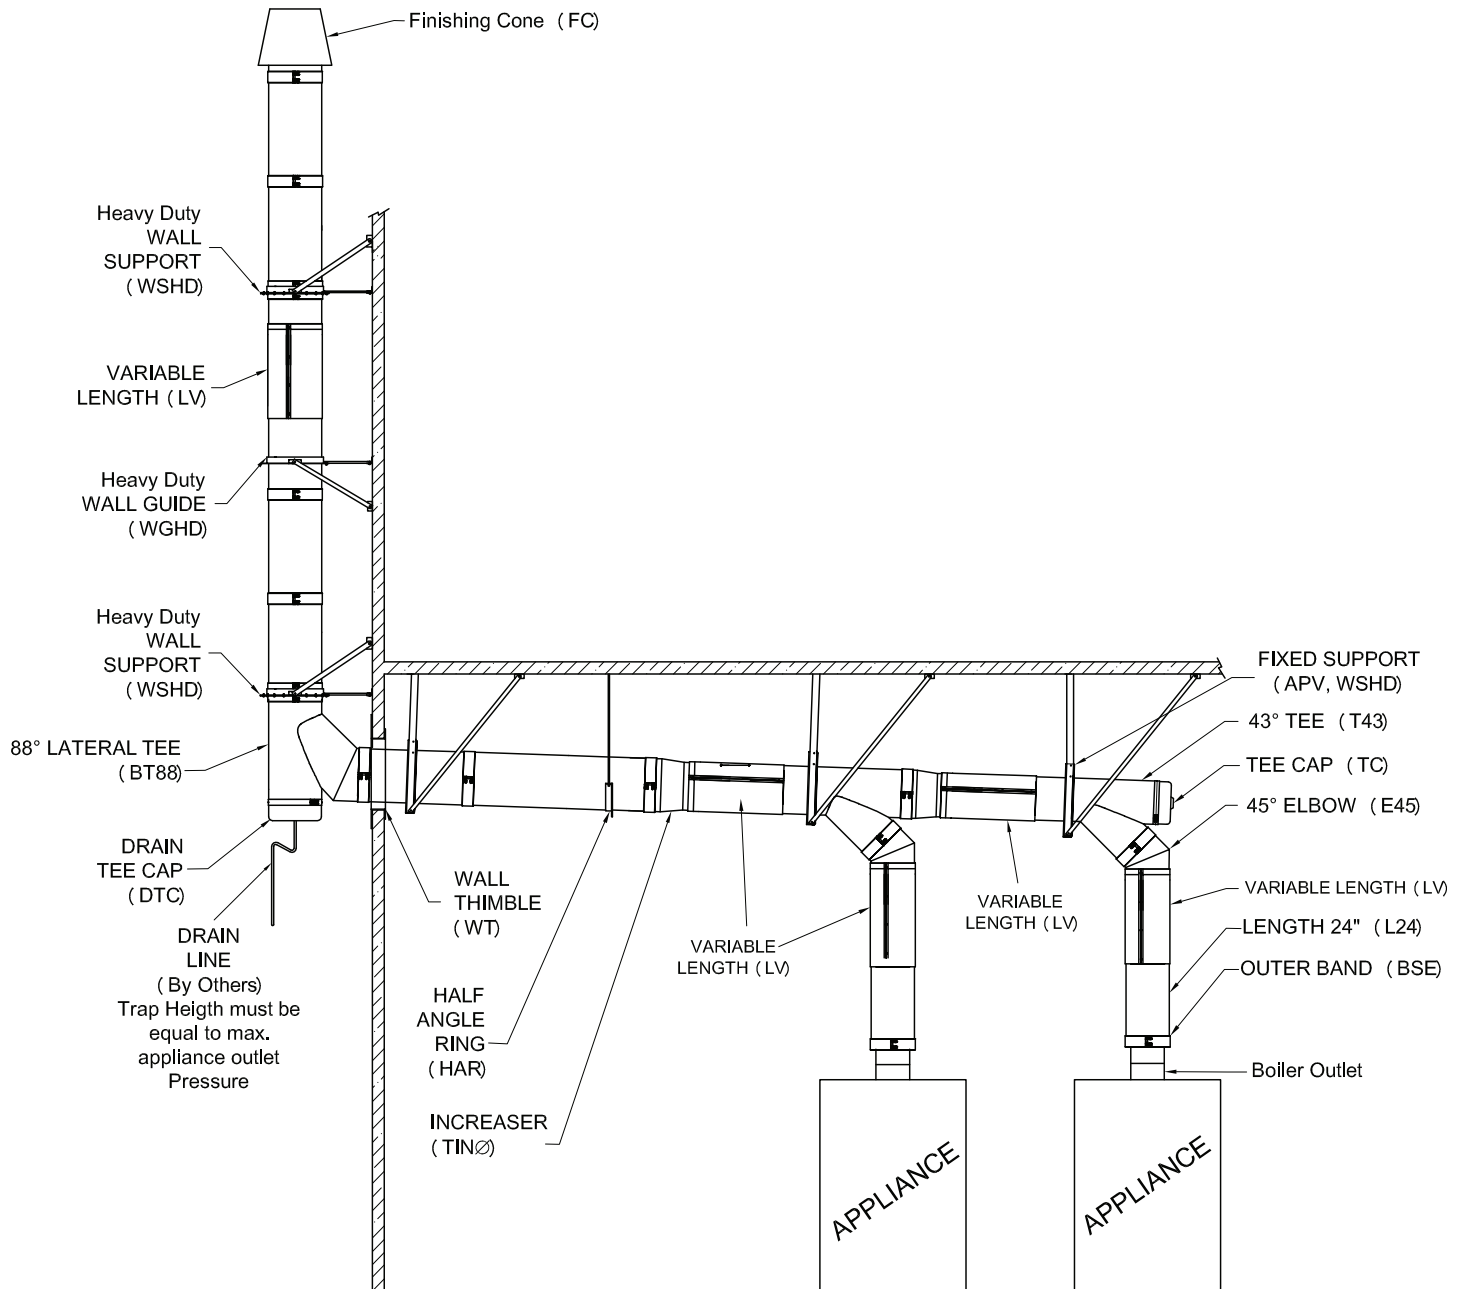


Figure 26- Typical installation for DSLD

TYPICAL INSTALLATION FOR DSLS & DSLD (26" TO 36")

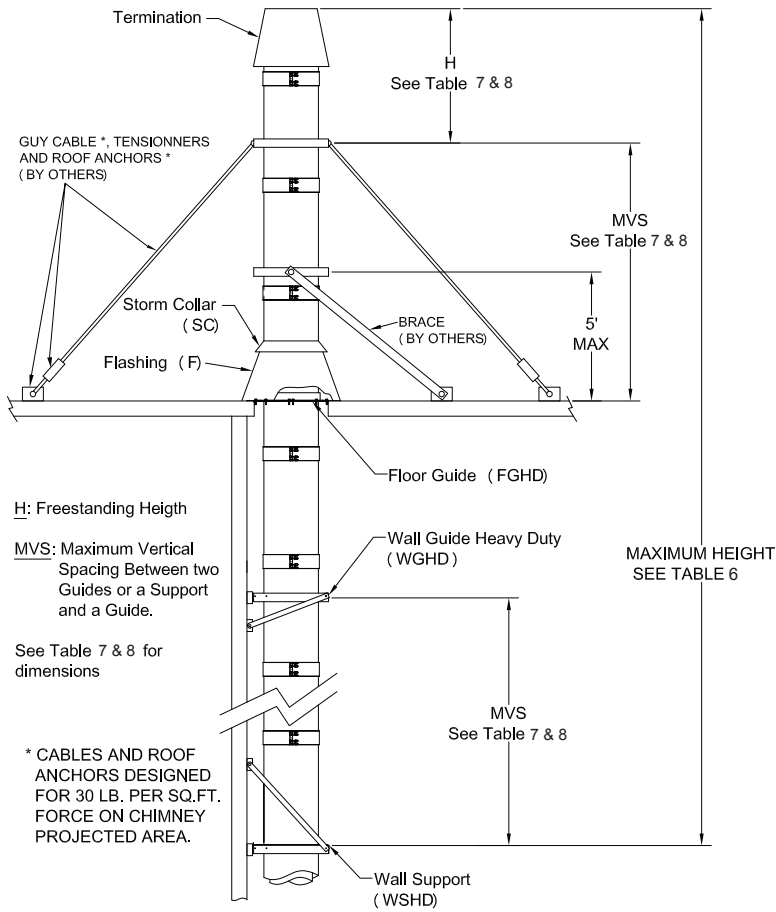


Figure 27 - Height with rigid bracing or guying option for DSLS & DSLD

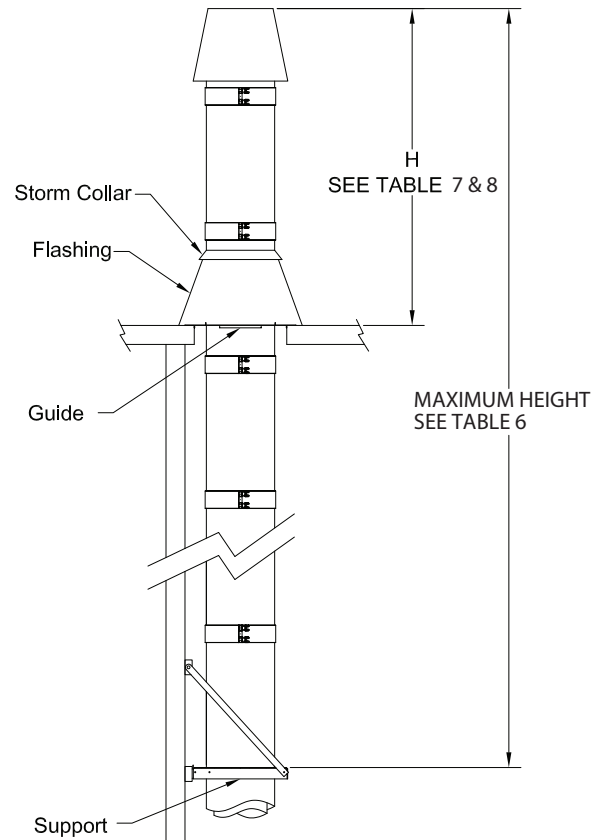


Figure 28- Maximum freestanding Height for DSLS & DSLD


• If Dimension "H" exceeds the value in the Table 7 & 8, use bracing or cable guying to stabilize chimney section above the roof. See Figure 27

JOINT ASSEMBLY (DSLS-DSLD)

All components have a male and female end: the male end has a flue extension and a black Viton® O-ring gasket (bottom side).

CAUTION: Each section must have an O-ring on its male end. If not, it may impair the sealing effectiveness. For any VERTICAL installation (except for Variable Length (LV), no need for caulking when using the O-ring. For any HORIZONTAL installation, add a bead of Viton® caulking over the Viton O-ring to properly caulk.

NOTE: Diameter of the DSLD shown in pictures for the installation assembly are smaller than reality.

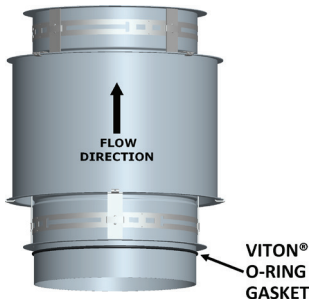

Joint Assembly Step 1


STEP 1:

Before installation, make sure there is a black Viton® O-ring on the flue extension

STEP 2 (for HORIZONTAL installation only):

Only on Horizontal installation, add a bead of black Viton® caulking over the Viton® O-ring.


NOTE: Sealant Caulking is supplied by DuraVent and Individual tubes are marked Fluorodyn Caulk VITON® code: VITON-S (2.5 oz), VITON-L (11 oz). It must be ordered separately. See Table 14 for number of tubes per joint.

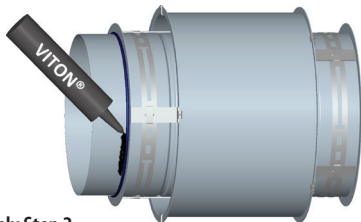

Joint Assembly Step 2

STEP 3:

For an easier installation, place the Inner V-Band (BSIK) on the spacers below the flange of the first section. Join the two flanged ends of the duct section together until it squeeze the Viton O-ring between both flanges.

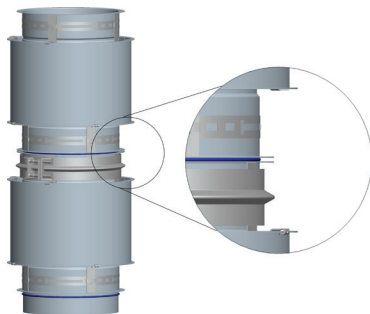

Joint Assembly Step 3

STEP 4:


Install the V-Band around the flanges making sure the flanges are located within the V-Clamp.

NOTE: Do not locate V-Band hardware at the bottom side of horizontal duct joints.

STEP 5:

Tighten the screws of the band with a screwdriver only (no screw gun).


NOTE: Light tapping with a hammer all around the band while tightening bolts helps align and pull flanges together.

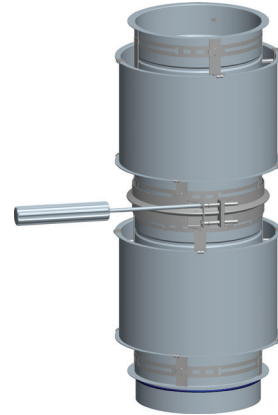

Joint Assembly Step 4-5

STEP 6 (for DSLD only):

Secure the Outer Casing with the Outer Band (BSE) and use a screwdriver to tighten the screws (no screw gun).

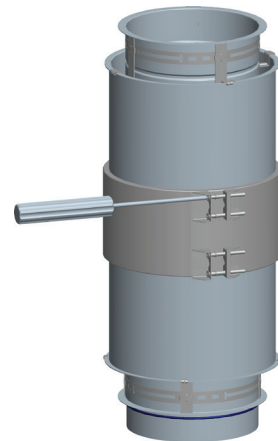

Joint Assembly Step 6

TABLE 14 - Expected number of tubes (11 oz) of Viton® per Joint Assembly or of S-375 for exterior weathering

Inner Duct Diameter	Number of Tubes Per Joint
26	1/2
28	1/2
30	2/3
32	2/3
34	2/3
36	2/3

STRAIGHT SECTIONS (DSLS-DSL D)

VERTICAL DRAIN LENGTH (DL)

A Drain Section is used to drain water on vertical installation. It is a special variation of an 18" pipe length with provision to drain rain or condensate from the chimney. The pipe flue is equipped with an annular gutter wall and a 1" (25) NPT nipple extending through the casing for attachment of drain piping. See **Figure 29** for details. The drain piping should include a water leg of a height at least equal to the maximum expected operating pressure at the appliance outlet to avoid allowing flue gases to vent through the drain. Drain Length should be installed indoors to prevent freezing.

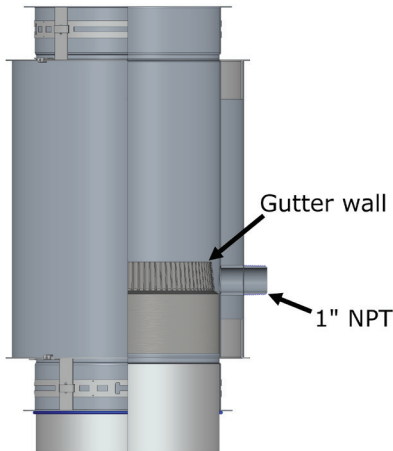


Figure 29- Vertical Drain Length

HORIZONTAL DRAIN LENGTH (HDL)

1. Horizontal Drain length is equipped with a 1" (25) NPT nipple, which is attached to the inner flue and extends through the outer casing to provide a path to drain, condensate or water from the chimney. See **Figure 30**.

2. A dam is attached to the inside of the inner flue adjacent to the nipple to channel the effluent to the drain.

3. The duct drain is intended for use at the end of a horizontal run where access and drainage is needed (see **Figure 30**).

4. The drain coupling must be connected to a "P" trap or approved container (supplied by others).

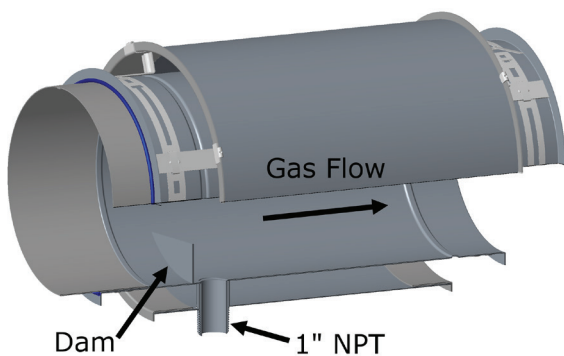


Figure 30- Horizontal Drain Length

VARIABLE LENGTH (LV)

The Variable Length (LV) has one major function. It makes up odd lengths of duct. It must not be used for expansion compensation.

It is shipped with a flanged retaining band assembly on the inner sliding wall. See **Figure 31**.

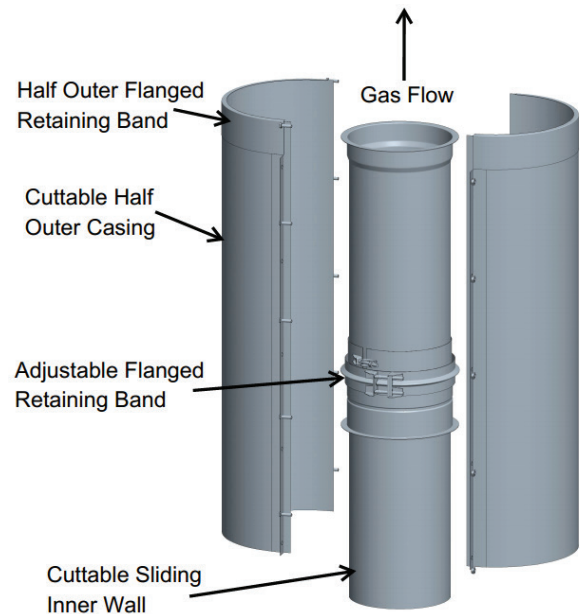


Figure 31- Variable Length (LV)

The whole LV assembly includes:

- A sliding inner wall that fit closely inside a standard pipe section and it is flanged on one side.
- An adjustable flanged retaining band, composed of;
 - Double flanged sleeve
 - Retaining flanged collar
 - An inner V-Band (BSI)
 - A different Inner Band (BS)

DSL D Only

- Split outer casing with flanged half band on the top side only.

NOTE: Viton® caulking must be applied on each Variable Length (LV) and must be supplied by DuraVent. Sealant must be ordered separately (Not included in the LV assembly).

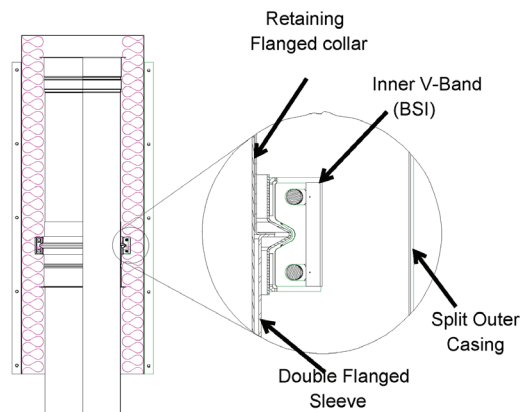


Figure 32- Detail of Variable Length

Flange to flange length adjustment can range from 7"x 281/2"

NOTE: If the flue is too long to fit into the adjacent section of duct without interfering with the flow path, it should be trimmed to desired flange to flange length plus an overlap of 4" with the inner wall of the inlet end duct section. The minimum overlap for the outer casing is 1" with the inlet end section outer wall. (See Figure 33 & 35a).

NOTE: If an LV joint must be joined to one of these fittings, the unflanged end of the tube should always point downward or towards downward slope.

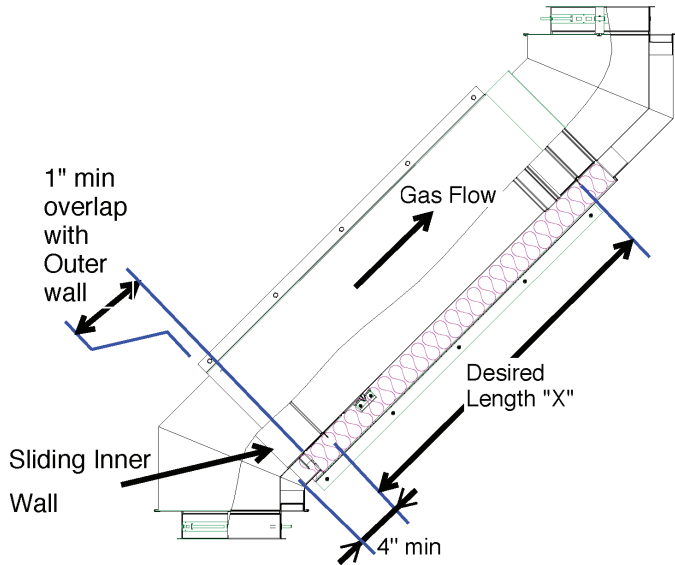


Figure 33 - Overlap Details for Variable Length

INSTALLATION STEPS FOR THE VARIABLE LENGTH (LV) (DSLS-DSLD)

Step 1 - Measure the distance X required for the variable length. See Figure 34.

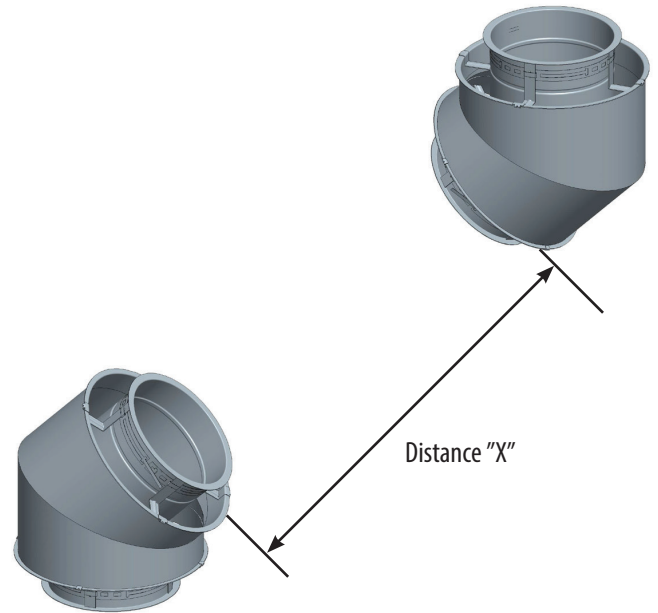


Figure 34-Step 1 for Installation of Variable length

Step 2 - Cut the inner wall at the dimension X found at the first Step plus 4". See Figure 35a.

Step 3 - Cut the split outer casing on the opposite side of the flanged half at dimension X plus 1". See Figure 35b.

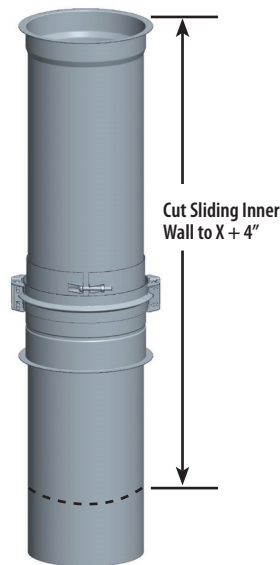


Figure 35a - Step 2 -
Cut of the Sliding Inner Wall

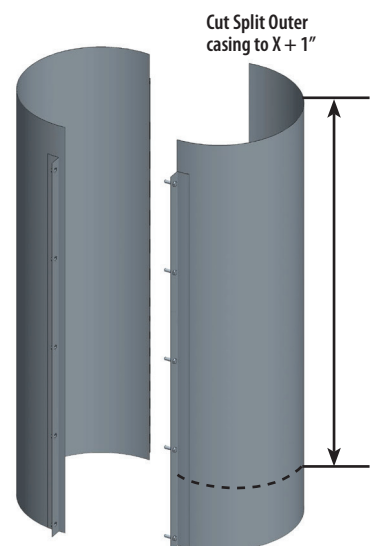


Figure 35b - Step 3 -
Cut of the Outer Casing

Step 4 - Install the interior assembly between the two parts. Place the adjustable flanged band assembly toward the downstream section.

Step 5-Assemble the outlet end sliding innerwall to the outlet end section as a regular section (See JOINT ASSEMBLY section). See **Figure 36**.

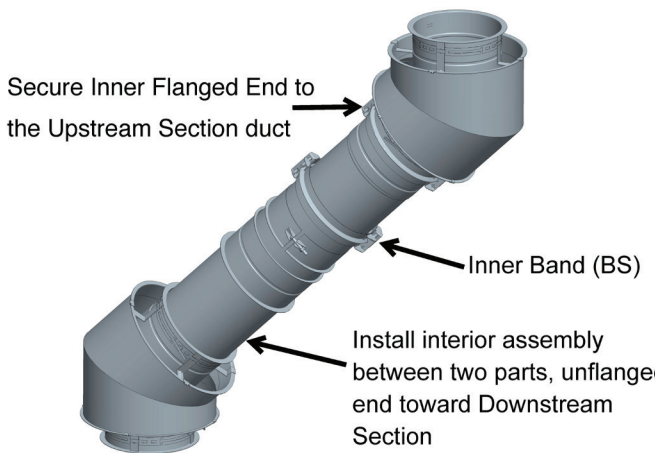


Figure 36 -Step 4-5- Install the inner LV and secure the outlet end flange

Step 6 - Before assembling the double flanged sleeve to the inlet end section, add a thin coat of sealant about 1" wide and a thin coat of sealant at the unflanged end of the LV joint whee the joint slides into the mating duct section. Press sealant into any gap between the LV and the mating joint section.

Step 7 -Assemble the inlet end flange assembly with the inlet end section flange as a regular length installation (See JOINT ASSEMBLY section).

Step 8 - Apply thin layer of sealant inside the retaining collar, and also a continuous bead of sealant at the collar overlap seam. See **Figure 37**.

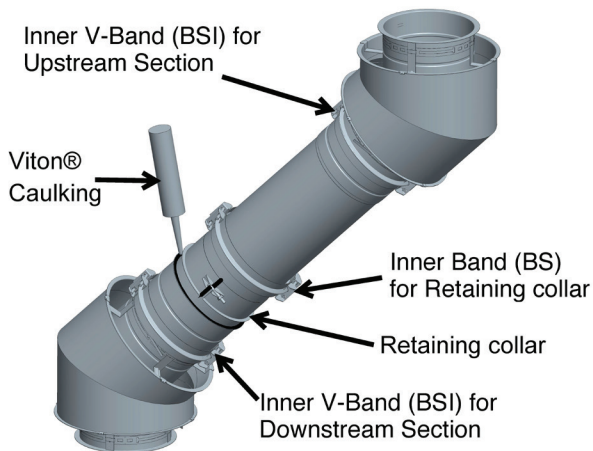


Figure 37- Step 7-9- Secure the Double Flanged Sleeve and seal the Retaining Flange Collar

Step 9 -Slide down the retaining band on the double flanged sleeve to mate their flanges and tighten the retaining collar.

Step 10 -Then install the other V-band (BSI) over these flanges (like regular joint assembly). See **Figure 38**.

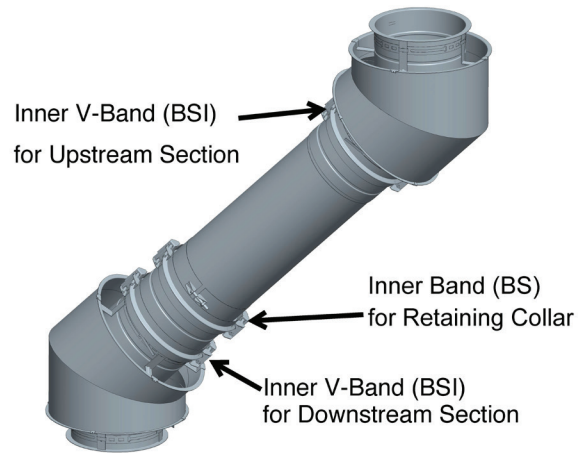


Figure 38 - Step 10-11 - Secure the Retaining Flanged Band

Step 11 - Install the split outer casing that covers from the outer wall of the inlet end section to the outerwall of the outlet end section. See **Figure 39**

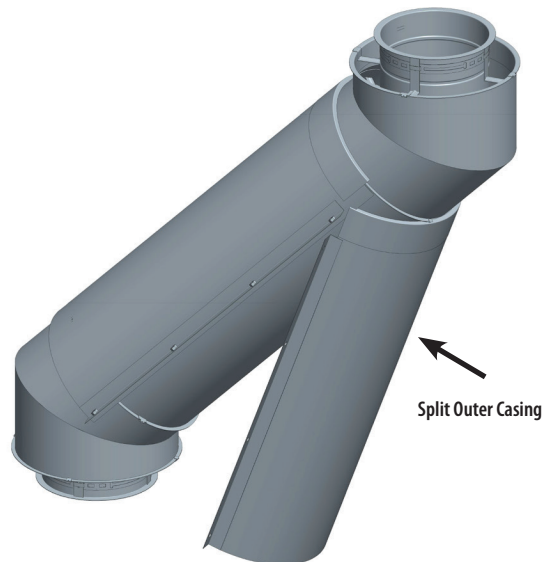


Figure 39 - Step 12- Install the Split Outer Casing

CAPS (DSLS-DSLD)

TEE CAP (TC)

The Tee Cap provides access for cleaning and inspection. Usually on horizontal runs, the Tee Cap is used to close the unused port of any Tee and for clean out or access purposes only. When using clean-outs, always seal the connection to prevent leaks.

The part list includes;


1x Cap with one Handle

1x smaller V-Band (BSI)

The next Items are for the Model DSLD only:

1x Outer Casing

1x Larger V-Band (BSI)

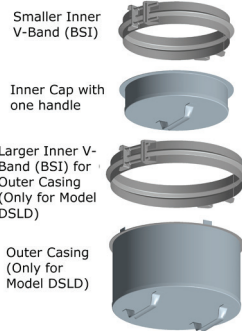

INSTALLATION PROCEDURES

STEP 1- (only for horizontal installation): Add Viton® Caulking over the Viton O-ring Gasket. See **Figure 40a**.

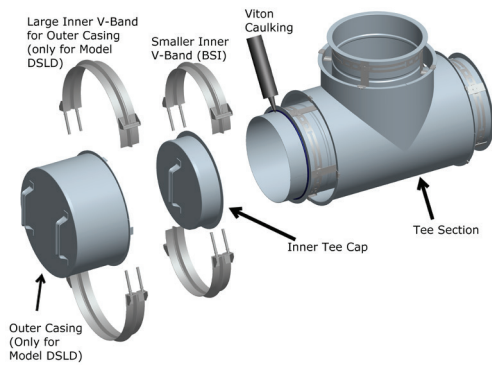


Figure 40a: Step 1 (only for Horizontal installation) Installation of the TC

Step 2 -Use the inner V-Band (BSI) to secure the inner Cap Kit to the flange of the 90° Tee (T90, not included) as specified in the JOINT ASSEMBLY section.

NOTE: Be sure the handle of the Cap faces outward as shown. See **Figure 40a or 40b**.

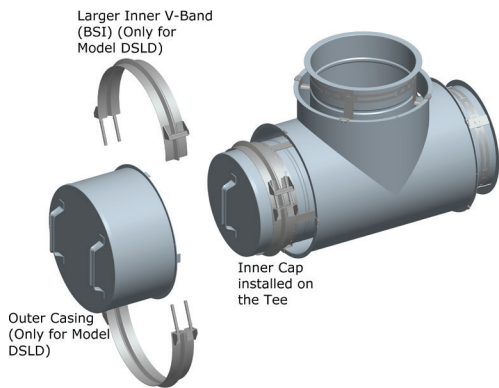


Figure 40b: Step 2 for installation of the TC

Step 3 - Mate the flange of the outer casing with the flange of the out wall of the Tee section.

Step 4 - Secure with the bigger V-Band (BSI) by tightening the retaining screw. See **Figure 40c**.

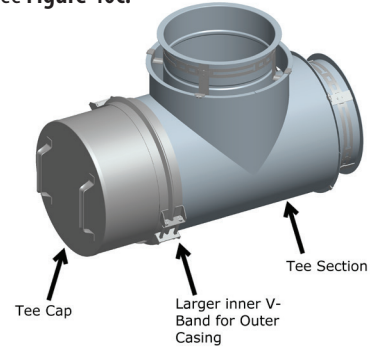


Figure 40c: Step 3-4 for installation of the DSLD TC

DRAIN TEE CAP (DTC)

The Drain Tee Cap (DTC) is used as a drain for the base of vertical installations and must be connected to a suitable disposable point. It can also be used as an access for clean outs or access purposes. (See **Figure 41**) Same installation as a Tee Cap (TC).



Figure 41: Drain Tee Cap (DTC)

ELBOWS (DSLS-DSLD)

ELBOWS (E2, E15, E30, E43, E45, E88, E90)

Elbows are used for changes in direction in horizontal or vertical portions of a system. All elbows feature the standard joint assembly as described in JOINT ASSEMBLY section. Elbows are used in combination to make different angles ranging from 2° to 90° in horizontal and vertical segments of the system.

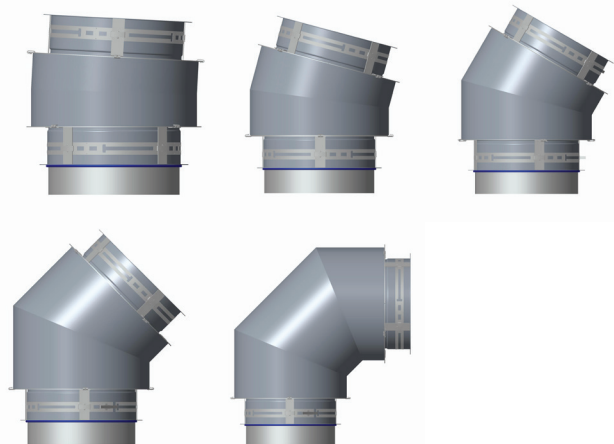


Figure 42: 3, 15, 30, 45 and 90° Elbow

Elbows are not designed to take bending loads and must be structurally supported. Structural parts such as posts or beams may also be needed to hold chimney supports in position. See ELBOW SUPPORT section.

OFFSETS (DSLS-DSLD)

1. The length of the offset is determined by strength considerations. The maximum dimension between supports is given in **Table 7 & 8**, and is applicable to all horizontal and sloped orientations. See **Figure 44**.
2. The minimum offset is accomplished with two elbows directly connected to each other (see **Figure 43** and **Table 15 & 16**).
3. With frequent re-support, there is no structural or operating limit to the length of horizontal or sloped portions, providing the system meets the capacity, pressure drop of available equipment.
4. The carrying capacity of supports and their structural attachments must take into account the weight of the offset plus whatever vertical section is carried by that support.
5. Height limits for supports are tabulated in **Table 6**.
6. The vertical sections above the offset must also be supported or anchored and guided where necessary.
7. Anchor Plate Wall Support (WSHD) and Wall Guide (WGHD) may be used in a variety of ways for offset support to achieve the structural stability of the system.
8. Re-supports must be securely anchored to walls, posts, or locally fabricated rigid framework. This framework must be designed to assure stability of supports, such as Ventilated anchor Plate (APV) supports and Heavy Duty Wall Supports (WSHD).
9. Supports suspended by threaded rods or from small size angles or straps are usually not satisfactory to resist bending moments due to offsets

Figure 43: Minimum Offset for each Elbows

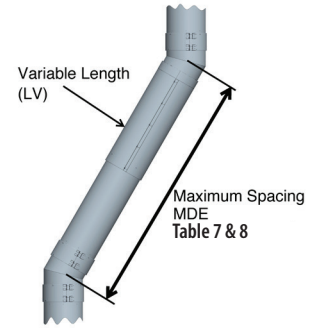
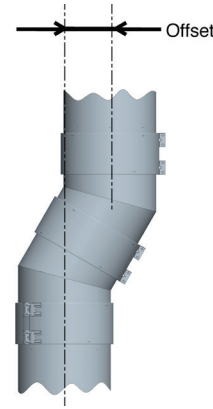


Figure 44: Maximum Spacing between supports for Offset

ADAPTERS (DSLS-DSLD)

TAPERED INCREASER (TINØ)

The Tapered Increaser Adapter is used for a diameter change in duct system. Uses when there is a sufficient length for duct run available for the size change. The TINØ is used uses 2" of length per 1" increment diameter change. The TINØ is considered to have the same load strength as a straight duct. See **Figure 45**.

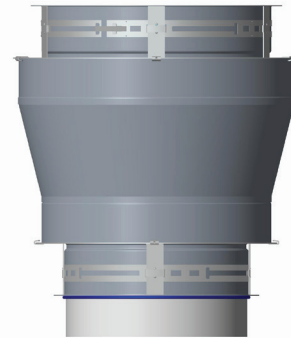


Figure 45: Tapered Increaser Adapter (TINØ)

ECCENTRIC TAPERED INCREASER (ETINØ)

The Eccentric Tapered Increaser Adapter is similar as the Tapered Increaser Adapter except the smaller diameter is offset from the larger diameter. When installed horizontally, the ETINØ keep a flat slope unlike the TINØ. See **Figure 46**.

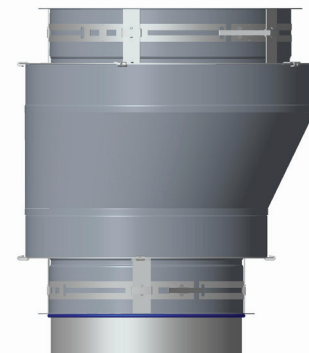


Figure 46: Eccentric Tapered Increaser (ETINØ)

DSLS					
Flue Diameter Ø (in.)	3°	15°	30°	45°	90°
26	3/8	2 5/8	6 7/8	12 7/16	34 1/4
28	3/8	2 11/16	7 1/8	13	36 1/4
30	3/8	2 3/4	7 3/8	13 9/16	38 1/4
32	3/8	2 7/8	7 5/8	14 1/8	40 1/4
34	3/8	2 15/16	7 15/16	14 3/4	42 1/4
36	3/8	3	8 3/16	15 5/16	44 1/4

TABLE 15 - Minimum Offset for Each Elbow - DSLS

Dimensions are in inches

DSLD					
Flue Diameter Ø (in.)	3°	15°	30°	45°	90°
26	1/2	3 1/4	8 1/8	14 3/8	39 1/2
28	1/2	3 1/4	8 3/8	14 7/8	41 1/2
30	1/2	3 3/8	8 5/8	15 1/2	43 1/2
32	1/2	3 3/8	8 7/8	16 1/8	45 1/2
34	1/2	3 1/2	9 1/8	16 3/4	47 1/2
36	1/2	3 1/2	9 1/2	17 1/4	49 1/2

TABLE 16 - Minimum Offset for Each Elbow - DSLD

Dimensions are in inches

SUPPORTS (DSLS-DSLD)

PLATE AND WALL SUPPORT

Ventilated Anchor Plate (APV)

Anchor Supports are designed to provide support to vertical sections and provide fixed-point support for horizontal sections. See **Figure 47**

NOTE: Rings installed at 90° to plates.

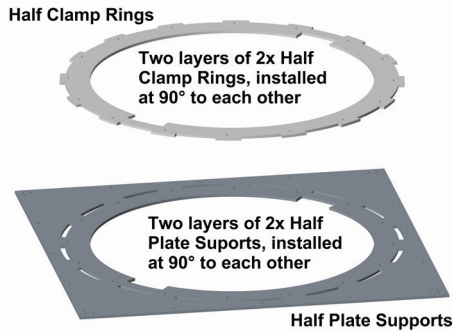


Figure 47: - Ventilated Anchor Plate for Combustible material

The Plate Support must be attached to the building structure or supported with rigid structural members. See **Table 6** for maximum supported height.

For maximum support, the entire perimeter of the Plate Support must be attached to structural framing. Structural members are supplied by the installer. See **Figure 48a and 48b**

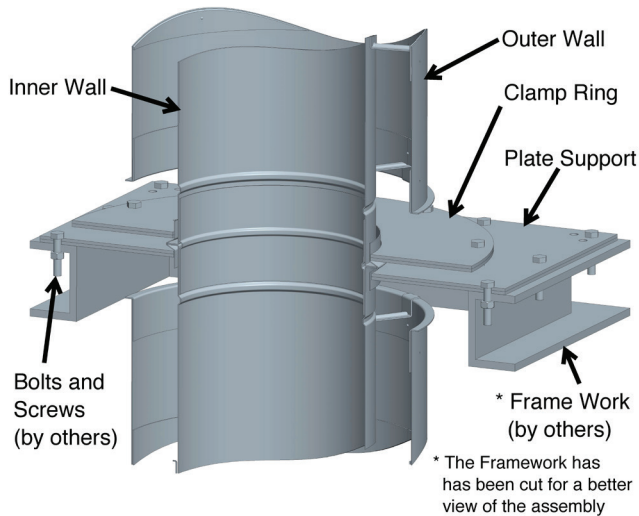


Figure 48a: - Ventilated Anchor Plate on a Framework

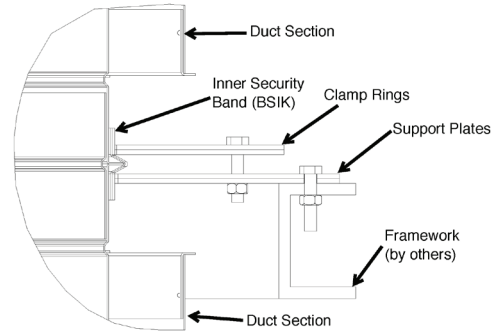


Figure 48b: Detail of the Ventilated Anchor Plate on a Framework.

Supported duct sections in a vertical position must be braced with diagonal members or gussets to prevent deflection of the supported joint as shown in **Figure 49**. "X" is a minimum of 30°.

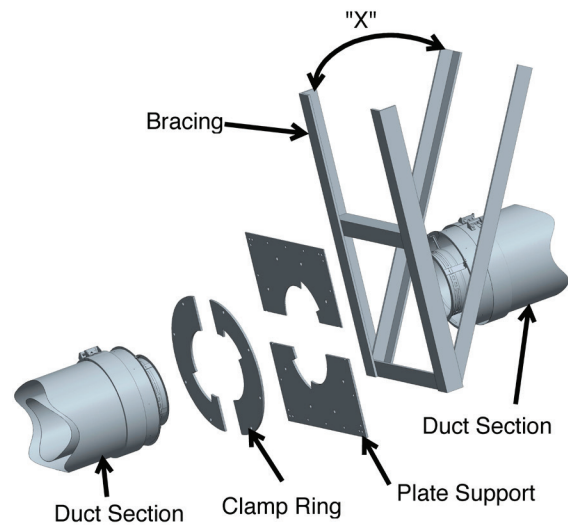


Figure 49: - Anchor Plate Horizontal Bracing

Plate Supports are usually located adjacent to fittings, such as tees or elbows, to protect fitting from expansion stresses. **Table 17** shows Plate Support, bracing and framework requirements for duct size ranges.

NOTE: If bracing is used, minimum "X" angle is 30°. If there is no bracing, the framework must be attached to structural members to provide equivalent rigidity.

Duct Diameter Ø (in)	Plate thickness (in)	Bracing (in)	Framework (in)
Ø26 @ Ø36	1/4	3 x 3 x 1/4 Channel or equivalent	3 x 3 x 1/4 Channel or equivalent

TABLE 17 - Minimum Acceptable Size for Framework and Bracing for Model DSLS / DSLD

VENTILATED ANCHOR PLATE WITH LENGTH (APVL)

The APVL support has the same use as the APV, but is easier to assemble (See Figure 50). Refer to the APV for all warnings/details, except for the installation of the part itself.

For the Model DSLD no outer wall is supplied. It is the Outer Band (BSE) that serves as the outer wall.

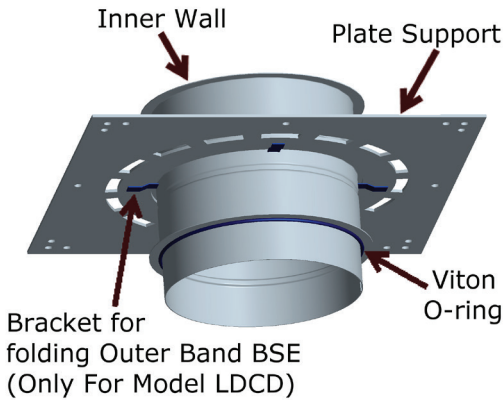


Figure 50: Ventilated Anchor Plate with Length (APVL)

For the Model DSLS, it is assembled exactly like flange-to-flange assembly with the V-Band (BSI) (See JOINT ASSEMBLY Section). Do only Step One for DSLS (See Figure 51)

For the Model DSLD, the part doesn't have any outer wall, but Outer Band (BSE) is provided to secure the insulation on the part. See Figure 51, 52 & 53 for the three steps to install the DSLD.

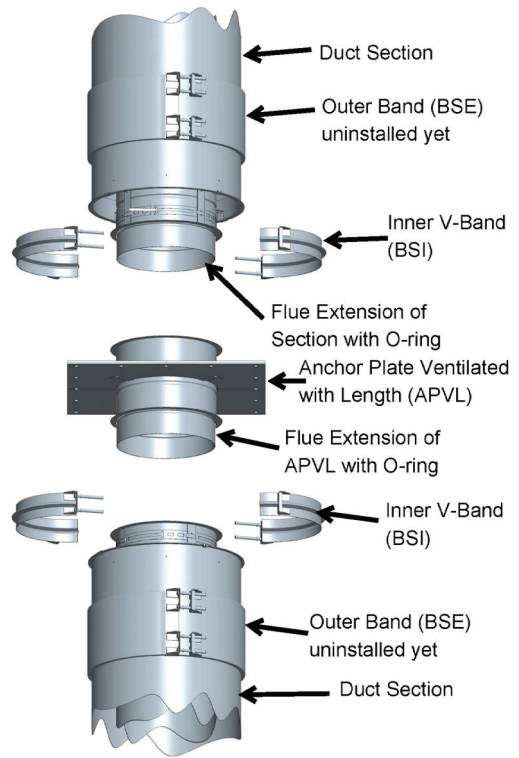


Figure 51: Step 1 of installation of APVL

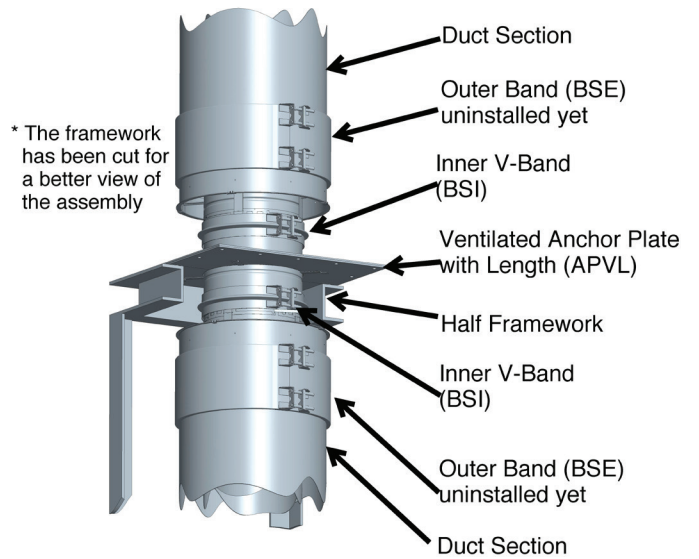


Figure 52: Step 2 of installation of APVL

For vertical installation, small brackets must be on the bottom side when the bottom Outer Band will be installed, these Brackets will hold the Casing Band (BSE) right to the support plates. See Figure 53.

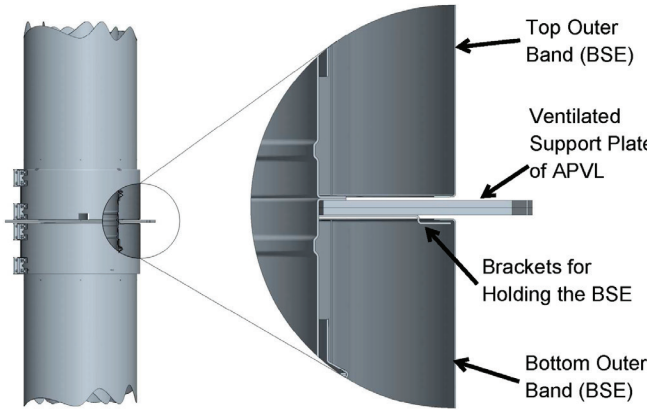


Figure 53: Step 3 of installation of APVL

HEAVY DUTY WALL SUPPORT (WSHD)

When attached to a non-combustible wall with brackets and struts, a Heavy Duty Wall Support makes up a fixed-point (See Figure 54a). The clamp rings are installed with the splits 90° apart so that they support each other. The notches in the clamp rings are aligned with the draw screws of the flange band. The Heavy Duty Wall Support Assembly is bolted together with provided hardware. It is made with adjustable struts, which allows a variable clearance from the non-combustible wall to the Chimney outer casing.

The minimum clearance varies with the size of the wall support, but is between 2 and 2 1/2" (based on the angle shape of the Full Angle Ring (FAR). See Figure 54b

The maximum clearance for all sizes is around 10". See Figure 54c

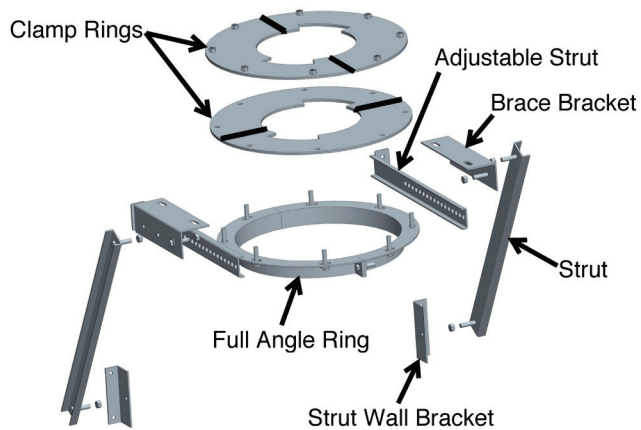


Figure 54a: Wall Support (WSHD)

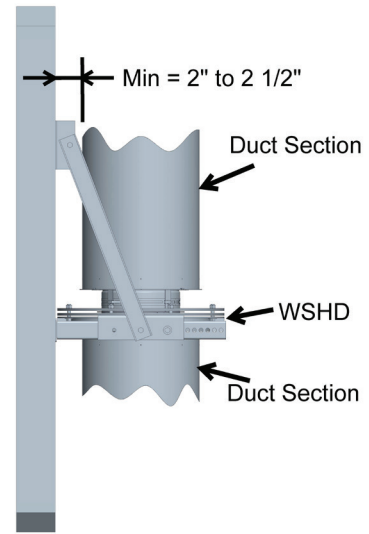


Figure 54b: WSHD Minimum Adjustment

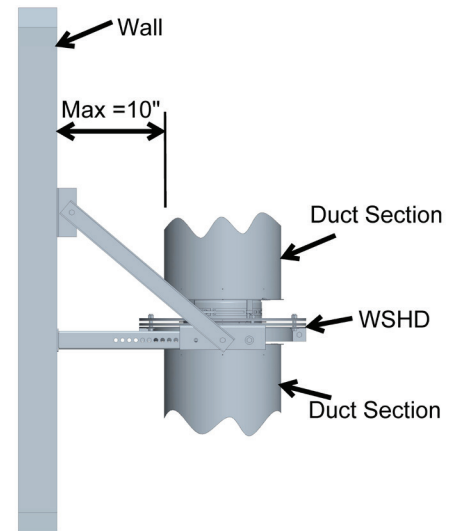


Figure 54c: WSHD Maximum Adjustment

HEAVY DUTY WALL GUIDE (WGHD)

The Heavy Duty Wall Guide is designed to complement the Heavy Duty Wall Support (See **Figure 55**). It is used as a lateral guide to prevent the duct from flexing due to lateral loading. The proper location for a WGHD is immediately below the outer closure band near the duct joint. The Heavy Duty Wall Guide is bolted together with hardware provided to form a rigid assembly.

- NOTE:** - Seal joint with S-375 sealant above and below support if exposed to weather.
- Can be attached to combustible wall

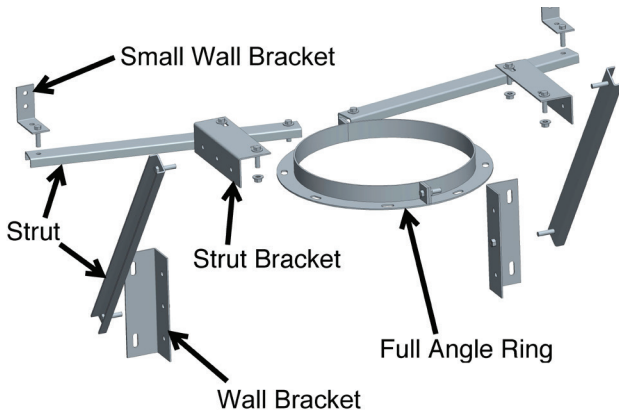


Figure 55: - Wall Guide Heavy Duty (WGHD)

FULL ANGLE RING (FAR)

A Full Angle Ring is used as a guide to prevent the duct from flexing due to lateral loading. The angle ring is split for ease of installation. It is 1/8" larger inside diameter than the outside diameter of the duct to allow movement of the duct inside the ring.



Figure 56: - Full Angle Ring (FAR)

HALF ANGLE RING (HAR)

A Half Angle Ring is used as a saddle in horizontal or sloped runs.

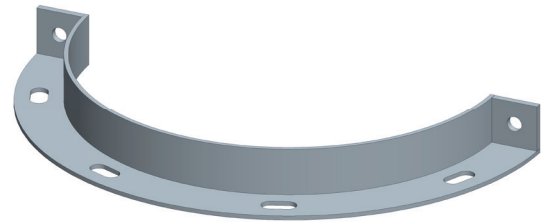


Figure 57: - Half Angle Ring (HAR)

LOCATION OF SUPPORTS (DSL5-DSL7)

Supports can be used in different combinations to secure the chimney in place. See **Figure 26, 27 and 28** for typical support and guide locations.

VARIABLE LENGTH SUPPORT

To prevent the LV from sagging, it is recommended that the duct section adjacent to a LV is supported or guided. See **Figure 58** for typical support locations for Variable Length. When necessary, properly guide the variable length by installing a Heavy Duty Wall Guide (WGHD) or any supports immediately below the joint of the next section.

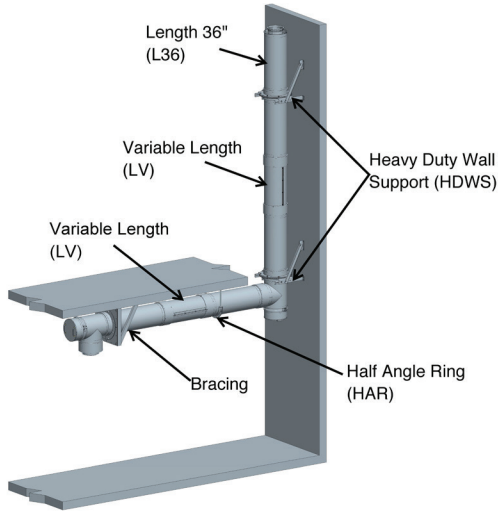


Figure 58: - Typical Installation locations for the Variable Lengths

NOTE: LV overlapping joints are not intended to support any weight in the vertical position. The inlet and outlet ends must each be supported.

TEE SUPPORT

The Tees must be supported properly to protect them from bending. It can be done by means of Anchor Plate (AP), Anchor Plate with Length (APL) or Heavy Duty Wall Support (WSHD)

When a tee is used at the base of the riser, the preferred location for support is above the Tee, thus suspending the Tee. See **Figure 59**

A Heavy Duty Wall Support (WSHD), a Ventilated Anchor Plate (APV) or a Ventilated Anchor Plate with Length (APV) can be used to support the TEE.

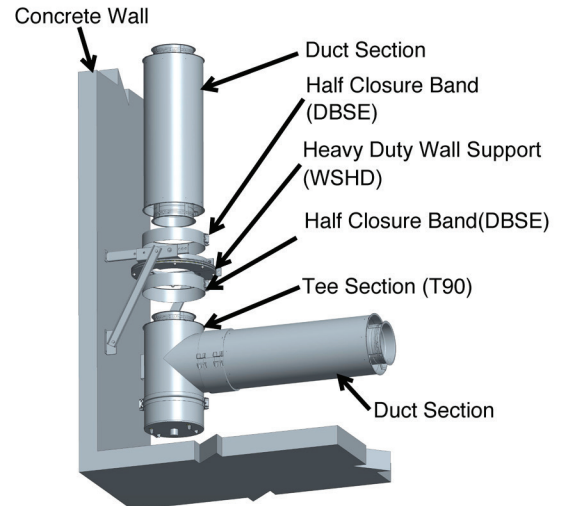


Figure 59: - Suspended Tee Support

NOTE: In the case of an AP, Flange joint of duct and Tee are to be secured in place between the Clamp Rings. If it is not possible to suspend the Tee, it may be supported with a base (a structural steel stand).

When a Tee is used as a supported Tee, A Drain Tee Cap (DTC) must be used at the bottom of the Tee for draining

ELBOW SUPPORT

Elbows are to be supported on one end with either a Ventilated Anchor Plate (APV), a Ventilated Anchor Plate with Length (APVL), or a Heavy Duty Wall Support (WSHD). See **Figure 60** for an example with an APV and **Figure 61** for an example with a (WSHD).

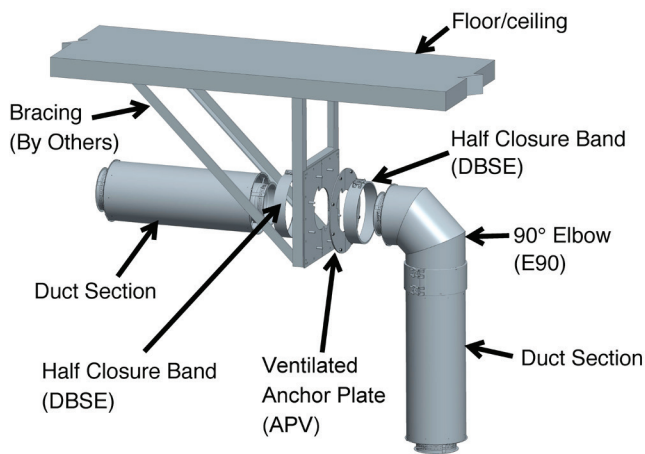


Figure 60: - Elbow with a Ventilated Anchor Plate (APV)

NOTE: In the case of an APV, flange joint of duct and elbow are to be secured in place between the Clamp Ring and square plate Support.

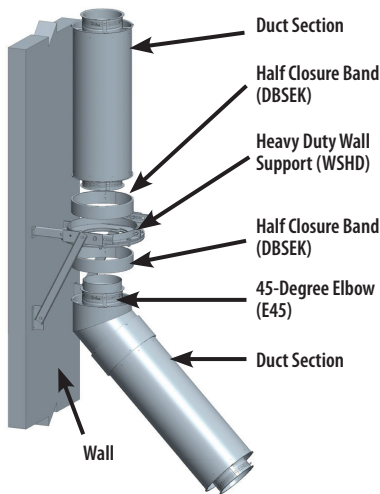


Figure 61: - Elbow with an Heavy Duty Wall Support (HOWS)

NOTE: Flange joint of duct and elbow are to be secured in place between the Clamp Rings

ROOF PENETRATION (DSLS-DSLD)

STORM COLLAR (SC)

The Storm Collar (SC) is used above the flashing for complete weatherization above the roof. It has to be sealed with the outer joint sealant (not included). See **Figure 62**.

FLASHING (F)

The roof Flashing (F) is used in conjunction with Storm Collar (SC) for weatherization on a flat roof. See **Figure 63**.

ADJUSTABLE FLASHING (F30)

The Adjustable Flashing (F30) is used in conjunction with Storm Collar (SC) for weatherization on a roof with a pitch 5° to 30°. See **Figure 64**.



Figure 62 - Storm Collar




Figure 63 - Flashing




Figure 64 - Adjustable Flashing

NOTE : The flashings are non-ventilated and does not provide for any reduced clearance to combustible.

INSTALLATION PROCEDURE FOR FLASHINGS

1. Cut opening to dimensions specified in **Table 9, 10 & 11**. See **Figure 65a** for flat roof and **Figure 66** for a sloped roof.

NOTE: Reinforced the edges of the hole as appropriate for the expected lead bearing requirements.

2. Slide chimney section through the hole.

3. For lateral stability, supports or guides must be used. The Heavy Duty Floor Guide (WSHD) must be installed on top of the roof. Any supports (APV, APVL or WSHD) or a Full Angle Ring must be installed below.

NOTE: Flashing is not intended to take any side load or wind loads

4. Install flashing over the chimney and the guide/support and screw it.

5. The Storm Collar (SC) is placed around the chimney and sealed to the casing with outer joint sealant S-350. See **Figure 66** for an installed Flashing (F)

The storm collar should not quite rest on the flashing when the chimney is cold (a 1/4" gap between the collar and the top of the flashing) .

NOTE: Maintain adequate spacing for expansion from the floor and the outer band (BSE) that is under the floor.

NOTE: If the maximum freestanding duct height above the Ventilated Anchor Plate (APV), Ventilated Anchor plate with length (APVL) or Full Angle Ring (FAR) exceeds that shown in the **Table 7 & 8**, guying is required.




Figure 65a - Minimum Opening for flat roof

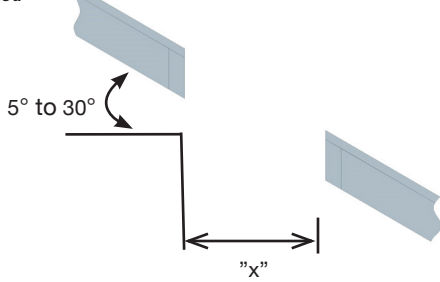


Figure 65b - Minimum Opening for sloped roof

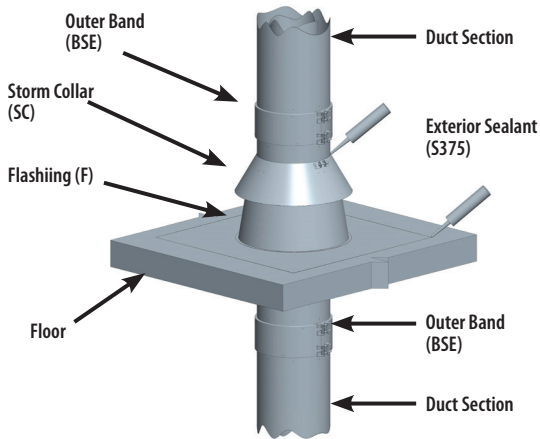


Figure 66 - Installation of Flashing- View Top of the Roof

MAINTENANCE INSTRUCTIONS

As with all vents, the DuraSeal vent system should be inspected at least annually for the presence of deposits or debris and any accumulation should be removed. The vent system should also be inspected at regular periods for signs of leakage of condensate or combustion products at any joints.

If the vent system incorporates a drain hose from either a Drain length or a Drain tee cap, the hose must be inspected periodically to ensure that water is in the trap loop. If a proper trap loop is not maintained, exhaust from the connected appliances may accumulate in the building area.

WARRANTY

These products have a limited warranty. Please read the warranty to be familiar with its coverage.

Retain this manual. File it with your other documents for future reference.

PRODUCT REFERENCE INFORMATION

Please contact DuraVent for the phone number of your nearest DuraVent dealer who will answer your questions or address your concerns.

Normally, all parts should be ordered through your DuraVent distributor or dealer. Parts will be shipped at prevailing prices at time of order.

When ordering repair parts, always give the following information:

1. The model number of the chimney system.
2. The part number.
3. The description of the part.
4. The quantity required.
5. The installation date of the chimney system.

If you encounter any problems or have any questions concerning the installation or application of this system, please contact our dealer.

DuraVent®

10 Jupiter Lane • Albany • NY, 12205
800-835-4429; www.duravent.com

DuraVent Limited reserves the right to make changes at any time, without notice, in design, materials, specifications, prices.
Consult your local distributor for chimney system code information.

Printed in Canada © 2016, 2017 DuraVent
PI DuraSeal L474 REV.02 07-14-17